

# PRODUCT CATALOGUE



**KEI**  
**Wires & Cables**

KEI has been at the forefront of India's wire and cable Industry for more than 5 decades. We manufacture a range of specialized cables and are important players in the domestic and retail segment. Our unblemished track record has earned us the patronage of leading Industrial houses, project consultants and architects. In order to provide reliable and expedient services to our customers, we have created manufacturing facilities at Silvassa, Chopanki, Bhiwadi, Pathredi and Chinchpada. Today, KEI is a one-stop-shop when it comes to meeting cabling requirements for the domestic, power and Industrial sectors. KEI has earned a formidable reputation by nurturing relationships, ensuring timely execution of orders and becoming a reliable partner in executing client projects. Our uncompromised cost-effective quality and reliable product range that meets rigorous technical requirements of our customers has made us an undisputed industry leader.

KEI carries out stringent quality control measures under surveillance of a competent team of technocrats and quality enablers. Continuous product innovations and cutting-edge R&D at KEI's in-house labs are what contribute towards constant evolution in our offerings and services. All KEI wires and cables are of a superior quality, a reason why they have been accredited and certified by Testing Agencies across the globe. KEI also has a substantial international presence with a global spread of clients spreading across 45 countries.



An ISO 9001:2015 certified company; KEI carries out stringent quality control measures under surveillance of a competent team of technocrats and quality enablers. Continuous Product Innovations and cutting-edge R&D at KEI's in-house labs is what contributes towards constant evolution in our offerings and services. All KEI's cables and wires are of a superior quality,a reason why they have been accredited and certified by Testing Agencies across the globe.



Troester's CCV Line Chopanki

## MANUFACTURING FACILITIES

A large infrastructure, spread over an area of 2,49,576 sq. metres across three strategically located units, supported by state-of-the-art production units, gives KEI the strength to meet the varied needs of its wide client base. No wonder KEI caters to over 100 large Indian companies covering almost all the industrial sectors.



CENTRAL POWER RESEARCH INSTITUTE		TEST REPORT	
Test Report Number	CDCO - 1610	Date	(05.06.2016)
<b>Item &amp; Address of the Customer</b>	Mr. Kali Industries Limited Plot No. 102, Sector 102, PECQ Industrial Area, Phase - II Shreed. Dist. Agra - 282103 (Uttarpradesh)		
<b>Item &amp; Address of the Manufacturer</b>	16A Kali Industries Limited Plot No. 102, Sector 102, PECQ Industrial Area, Phase - II Shreed. Dist. Agra - 282103 (Uttarpradesh)		
<b>Particulars of sample tested</b>	1.2 X 200 mm <sup>2</sup> Al-Copper AL/Pt Insulated, Standard Test Round wire-Alarmed, PVC Outer Sheath, 1500 V CAT Level 2		
<b>Condition of the sample as received</b>	Item : Copper Condition Material : Round Type of cover : Solid Size : 1.2 mm insulation : 0.25 mm Outer sheath : PVC (Black) Voltage Rating : 1500 V Envelope : KCI - CHARLES ELECTRIC 16103 VV SCN 006 05/06/2016 BES/CDCO, 161 CDA/2016/1849		
<b>Serial Number</b>	Nil	<b>Remarks</b>	None
Number of Samples tested	One	Date	05.06.2016 to 06.06.2016
(CRRI Sample Code No.)	CDCO/16103	Customer Reference No.	16103
<b>Particulars of test conducted</b>	<b>Type Test</b>		
Test in accordance with	As per IS 7008 Part I, 2011, rev.1 - 2010		
Standard reference	Not Applicable		
Sampling plan	Nil	Specimen	Nil
Customer's requirement	Nil	Witnessing	Nil
Comments	Nil	Comments	Nil
Name of the witnessing person	Name	Comments	Nil
Customer's representative	Nil	Comments	Nil
Other relevant information	Nil	Comments	Nil
Test authorized with witness	Nil	Comments	Nil
Comments concerning this report	Nil	Comments	Nil
Number of sheets	01	Number of pages	01
Number of tables	01	Number of figures	01
Number of graphs	01	Number of tables	01
Number of test circuit diagrams	01	Number of figures	01
Number of drawings	01	Number of tables	01
 <b>TEST ENGINEER</b>		 <b>ADDITIONAL DIRECTOR</b>	
Central Power Research Institute Ministry of Power, Government of India Sector 102, PECQ, Agra - 282103, U.P., INDIA Tel: +91-5222-211111, Fax: +91-5222-211112			
Page 1 of 1			

Standards Organisation of Nigeria Conformity Assessment Programme Product Certificate (Licensed)					
This document is cut and does not invalidate in any respect the SCONCAP Certificate required for Customs Declaration			PECC No.: L-10000000001 Issue Date: 08.04.2015 Expiry Date: 08.04.2016 Page No.: 1/2 Version: 2		
Supplier's Details		Product Description		Factory Audit Date:	
No.	No.	Product Name	Country of Origin	Standard Reference	
1	W001	ELECTRIC WIRES, CABLES, EXTENSION CORDS, COAXIAL/WIRELESS CONNECTORS (WOOD, PVC, THERMOPLASTIC, RUBBER, ETC.), METAL TO METAL CONNECTORS, PLUGS, RECEPTACLES, ALUMINIUM & COPPER, KEY INDUSTRIES LIMITED, NIGERIA LTD.	Nigeria	SNI 00000-0001 ISO 9001:2008 / IEC 60068-2-204 EN 60068-2-204 EN 60068-2-208 EN 60068-2-209	
2	W002	ELECTRIC WIRES, CABLES, EXTENSION CORDS, COAXIAL/WIRELESS CONNECTORS (WOOD, PVC, THERMOPLASTIC, RUBBER, ETC.), METAL TO METAL CONNECTORS, PLUGS, RECEPTACLES, ALUMINIUM & COPPER, KEY INDUSTRIES LIMITED, NIGERIA LTD.	Nigeria	SNI 00000-0002 ISO 9001:2008 / IEC 60068-2-204 EN 60068-2-204 EN 60068-2-208 EN 60068-2-209	
3	W003	ELECTRIC WIRES, CABLES, EXTENSION CORDS, COAXIAL/WIRELESS CONNECTORS (WOOD, PVC, THERMOPLASTIC, RUBBER, ETC.), METAL TO METAL CONNECTORS, PLUGS, RECEPTACLES, ALUMINIUM & COPPER, KEY INDUSTRIES LIMITED, NIGERIA LTD.	Nigeria	SNI 00000-0010 ISO 9001:2008 / IEC 60068-2-204 EN 60068-2-204 EN 60068-2-208 EN 60068-2-209	
4	W005	ELECTRIC WIRES, CABLES, EXTENSION CORDS, COAXIAL/WIRELESS CONNECTORS (WOOD, PVC, THERMOPLASTIC, RUBBER, ETC.), METAL TO METAL CONNECTORS, PLUGS, RECEPTACLES, ALUMINIUM & COPPER, KEY INDUSTRIES LIMITED, NIGERIA LTD.	Nigeria	SNI 00000-0004 ISO 9001:2008 / IEC 60068-2-204 EN 60068-2-204 EN 60068-2-208 EN 60068-2-209	
5	W006	ELECTRIC CABLES	Nigeria	SNI 00000-0011	

**TECHNICKÁ INSPEKCIÁ, a.s.**  
SLOVENSKÁ REPUBLIKA

**CEOC**  
PROFESIONAL

**CERTIFICATE**  
No.: 2050/12/2018

To technical file of equipment issued according of EN IEC/EN 61025-2-17/2008

Date of issue: 27th June 2018

Name of equipment: **LOW VOLTAGE ELECTRIC CABLES**

Type designator: **LC/POWER CABLE**

1x 1.5 mm <sup>2</sup>	1x 2.5 mm <sup>2</sup>
1x 4 mm <sup>2</sup>	1x 6 mm <sup>2</sup>
1x 10 mm <sup>2</sup>	1x 16 mm <sup>2</sup>
1x 25 mm <sup>2</sup>	1x 35 mm <sup>2</sup>
1x 50 mm <sup>2</sup>	1x 70 mm <sup>2</sup>
1x 95 mm <sup>2</sup>	1x 120 mm <sup>2</sup>
1x 150 mm <sup>2</sup>	1x 180 mm <sup>2</sup>
1x 240 mm <sup>2</sup>	1x 250 mm <sup>2</sup>
1x 300 mm <sup>2</sup>	1x 350 mm <sup>2</sup>
1x 400 mm <sup>2</sup>	1x 500 mm <sup>2</sup>
1x 500 mm <sup>2</sup>	1x 600 mm <sup>2</sup>
1x 600 mm <sup>2</sup>	1x 700 mm <sup>2</sup>
1x 800 mm <sup>2</sup>	1x 900 mm <sup>2</sup>
1x 1000 mm <sup>2</sup>	1x 1200 mm <sup>2</sup>

Manufacturer: **EPI Inspektorát Ltd.**  
DP - 911 520 4 002 INDUSTRIAL AREA, PEPINÍK,  
Bratislava, SK-841 01, Slovakia, 02/07/2018

Applicant: **S&S Inspektorát**

Status for certificate issuing: **Inspection report No.: 2018/0019**

After evaluation of submitted documentation of compliance (TCP) in accordance  
with Directive 2014/35/EU, Technical Regulation, as it is issued by the  
**certification**

The technical file of equipment fully satisfies requirements and it is in accordance  
with Low Voltage Directive 2014/35/EU.

The manufacturer may declare to the market according to Article 10 of the Directive, in accordance with Article 11(1) of the Directive, that the equipment complies with the essential requirements of the Directive.  
The manufacturer may declare to the market according to Article 10 of the Directive, that the equipment complies with the essential requirements of the Directive.

This certificate is valid until 27th June 2019.

*[Handwritten signature]*

Bratislava, 27th June 2018

On behalf of Technická inspekcia, a.s.

Ing. Štefan Petruš  
General Director

**TI**

CEOC PROFESIONAL

2050/12/2018

TI-2050-12-2018

**DNV GL**

**KEMA TYPE TEST CERTIFICATE OF COMPLETE  
TYPE TESTS**

<b>Object</b>	Multi-core power cable	<b>1036-17</b>
<b>Type</b>	PVC/SRHA/PVC/XLPE/mica/CU	<b>Serial No.</b>
Rated voltage, U <sub>0</sub> /U (%)	0.6/1.0 [1.2] kV	Conductor material
Conductor cross-section	4x9x0.1x25 mm <sup>2</sup>	Insulation material
		Cu XLPE
<b>Manufacturer</b>	KEI Industries Ltd. S-100, Sector 10, Phase III, RTICO Industrial Area, Bhawali (Kalyanpur), India* KEI Industries Ltd. Rajapalayam, Tamil Nadu, India	
<b>Client</b>		
<b>Tested by</b>	DNV GL, Netherlands B.V., Arnhem, the Netherlands	
<b>Date of tests</b>	20 December 2016 to 20 February 2017	
<p>The object, constructed in accordance with the description, drawings and photographs incorporated in this Certificate, has been subjected to the series of proving tests in accordance with the complete type test requirements of:</p> <p style="text-align: center;"><b>IEC 60502-1 (2009)</b>      subsection 17 and 18</p> <p>This Certificate has been issued by DNV GL following exclusively the STL Grade.</p> <p>The results are shown in the record of proving tests and the oscillograms attached hereto. The values obtained and the general performance are considered to comply with the above standard(s) and to justify the ratings assigned by the manufacturer as listed on page 5.</p>		
<p>This Certificate applies only to the object tested. The responsibility for conformity of any object having the same type references as that tested rests with the Manufacturer. * As declared by the manufacturer.</p> <p>This Certificate consists of 34 pages in total.</p> <p style="text-align: right;">Dgtr. Co. Nederlandse B.V.  Executive Vice President KEMA Laboratories</p>		
 <b>KEMA</b> Laboratories Arnhem, 28 February 2017		

DNV GL is a registered trademark of DNV GL Group. DNV GL is not involved in the preparation of this document. Responsibility for the contents of this document lies with the client. The client is responsible for the correctness of the information contained in this document. The client is also responsible for the use of the results of the tests.

Industry & Facilities Division		Page : 1 of 2	
 <b>RELEASE NOTE N°</b> <b>TECHNIP/DEL/075990C001-08162/RN-003</b> <small>DN: JASIN, MELA, 00000000000000000000000000000000</small>		<input checked="" type="checkbox"/> Completely <input type="checkbox"/> Partially	
<b>MATERIAL / ITEM / MANUFACTURER / P.T.</b> All Client via TECHNIP INDIA - DELHI, RAJ. JCN 00000000000000000000000000000000 <b>Manufacturer:</b> MIL-ALI INDUSTRIES LTD. <b>Serial No:</b> 00000000000000000000000000000000 <b>Date:</b> 10/11/2010 <small>For more information see the Inspection Report I-075990C001-08162/RN-003</small>		<small>PO Box 102 P.O. Box 102 PO BOX 102 PO BOX 102</small>	
<b>MATERIAL / SUBJECT OF INSPECTION</b> Inspection Communication Cable <small>As per Annexure-I</small>		<small>DATE</small> 10/11/2010	<small>TYPE</small> Approved for Inspection
		<small>Approver</small> As per packing slip <small>Annexure-I</small>	<small>Approver</small> As per Annexure-II <small>Annexure-II</small>
<b>CONCLUSION / REMARKS :</b> The test item has been released in accordance with specification and passes all the requirements in view of the time of inspection.			
<b>Date of Inspection:</b> 10 NOV 2010 <b>For Details Refer Inspection report No:</b> TECHNIP/DEL/075990C001-08162/RN-003			
<b>Inspected by:</b> Name: Tejinder Singh		<b>Checked by:</b> Name: Mr. K.V.Rahul	
<small>Date of issue: 10.11.10 Registration number: 0155, Delhi</small>		<small>Vinay Ditrangre</small>	
<small>This test is issued under an inspection license. Details and copies were issued by the Client and of the customer with BSI privilege. This note is to act as an indication that the article is fit for its intended purpose and can be used without any restrictions. The article is fit for its intended purpose, generation, integration, neither contains anything to cause without limitation, damage, wear and tear, deterioration, or any other damage to the article.</small>			
<small>This test is issued under an inspection license. Details and copies were issued by the Client and of the customer with BSI privilege. This note is to act as an indication that the article is fit for its intended purpose and can be used without any restrictions. The article is fit for its intended purpose, generation, integration, neither contains anything to cause without limitation, damage, wear and tear, deterioration, or any other damage to the article.</small>		<small>RECEIVED 15-Nov-2010 RECEIVED 15-Nov-2010</small>	
<small>This test is issued under an inspection license. Details and copies were issued by the Client and of the customer with BSI privilege. This note is to act as an indication that the article is fit for its intended purpose and can be used without any restrictions. The article is fit for its intended purpose, generation, integration, neither contains anything to cause without limitation, damage, wear and tear, deterioration, or any other damage to the article.</small>			

 Certificate No: T-1411	<b>ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION</b> ESTD 1947 by National Council of Science & Industrial Research, Department of Science & Technology, Govt. of India EPAK - B-11 (022) 2434942, 2434964, 2642077, 200128 / 29 / 30 / 31 / 33 Fax : 022 2438392 E-mail : erda@erda.org Web : http://www.erda.org		 
<b>TEST REPORT</b>			
SHEET 1 of 4			
<b>NAME &amp; ADDRESS OF CUSTOMER</b> KEI Industries Limited, Bhawali Unit : SP-919/920/922, RILCO Industrial Area, Bhawali, Ahmedabad, Distt. Alwar - 301019 Rajasthan		<b>REPORT No.</b> : RP-1415-D3782 <b>DATE</b> : 05-03-2015 <b>CUSTOMER REF. NO.</b> : 1 KEL/OC/RMNC/C/14-02 <b>DATED</b> : 13-03-2015 <b>DATE OF SAMPLE RECEIPT</b> : 24-02-2015 <b>DATE OF TESTING</b> : 02-03-15 to 03-03-15	
<b>SAMPLE DESCRIPTION</b> 3 Core x 400 Sq.mm stranded shaped insulated conductor, 100% XLPE insulated, Extruded LSZH (LTS-1) inner sheathed, G.S. wire armoured and overall LSZH (LTS-1) sheathed cable as per IEC 60793-1 Voltage Grade : 0.6/1.0 KV Drum No. : X-99538 Sample Length : 350 mm (Approx.)		<b>SAMPLE IDENTIFICATION</b> Embossing : SQ MM 2015 CUI XLPE, LSZH BS 6729 - FOR 2MWC Printing : KEI ELECTRIC CABLE 600/1000	
<b>Sr. No.</b>		<b>TEST DETAILS</b>	
1		Oxygen Index test	
2		Tensile Strength test	
3		Determination of halogen acid gas content on PP filters	
		<b>TEST SPECIFICATION</b> ASTM D-2863 : 2013 ASTM D-2863 : 2013 IEC 60794-1 : 2011	
 PREPARED BY		 CHECKED BY	
<b>Notes :</b> <ol style="list-style-type: none"> <li>This report relates only to the particular sample received for testing in good condition at ERDA.</li> <li>This report cannot be reproduced in part under any circumstances.</li> <li>Any discrepancy between this report and any other document issued by the Director, ERDA, may be resolved only by the Director.</li> <li>Only the tests listed for by the customer have been carried out.</li> <li>Any deviation from the test specification will be mentioned &amp; will be commented, as far as possible, where the cause has arisen.</li> </ol>		 APPROVED BY Mr. R. Patel (TDS) (TDS)	
<b>Caution :</b> ERDA is not responsible for the authenticity of purchased or reproduced test reports. ERDA provides support to customers for verification of the authenticity of test reports issued by ERDA.			

 <b>ЭКСПЕРТ-СЕРТИФИКАЦИЯ</b> Объекты и инженерные системы «Эксперт-Сертификация» (ЮОО «Эксперт-Сертификация») Юридический адрес: 00000, г.Курск, ул.Панфилова, д.53, кв. 2 Телефон/факс: +7 (473) 77-04-91. Адреса электронной почты: <a href="mailto:info@expert-sertif.ru">info@expert-sertif.ru</a> , <a href="mailto:info@expert-sertif.com">info@expert-sertif.com</a>	<b>КЕИ INDUSTRIES LTD</b> Адрес: AP-A18, KII, 922, EKIZ POD-ETILOM, AREA PHASE-02, BISHKEK, KYRGYZSTAN 720011, Kyrgyzstan
<b>Информационный блок:</b> <p>Одним из сертифицированных производителей Объекта и инженерных систем «Эксперт-Сертификация» (договор № РА.001/11/012 от 18.12.2013 г.) информирует Вас о том, что указанное выше предприятие, а именно производитель соответствует критериям, указанным в Техническом регламенте оценки ОУ (Базисного технического оборудования) (TR TC 004/2011), утвержденному Решением Комиссии Таможенного союза от 14.08.2011 № 748, техническому регламенту Таможенного союза «Электротехническая промышленность пищевой промышленности» (TR TC 020/2011), утвержденному Решением Комиссии Таможенного союза от 09.12.2011 № 479.</p>	
<b>Параметрические признаки</b>	<b>Код ПРИЗД</b>
<p>Системы на базе термопары марки КЕИ под напряжение стабильны (±10%)            Их можно использовать в диапазоне температур от -50 до +150 °C.            Их можно использовать в диапазоне температур от -50 до +150 °C.            Их можно использовать в диапазоне температур от -50 до +150 °C.            Их можно использовать в диапазоне температур от -50 до +150 °C.</p>	<b>0104 02 00 9</b>
Оформление сертификата соответствия и приемка документов о соответствии не требуется.	
	
Руководитель: ОС 124 000, Системы Сертификации Дата: 11.12.2013, Адресата	

## CLIENTS AND SECTORS



### MINING

- SECL
- WCL
- ECL
- Hindustan Zinc
- Marble Industries
- Birla Copper

### FERTILIZERS

- National Fertilizers Ltd
- Indo Gulf Fertilizers
- Indian Farmers & Fertilizers Corporation
- Gujarat State Fertilizers Co-operative Corporation
- Chambal Fertilizers
- Deepak Fertilizers
- Zuan Agro
- Rashtriya Chemicals and Fertilizers
- Tata Chemicals
- Hindustan Fertilizers Co. Ltd.

### TELECOMMUNICATION

- Bharat Sanchar Nigam
- Basic Operators and Telecom Networking Engineers
- Cyprus Telecommunication
- Spice Telecom
- Marconi
- Secure Meters
- Reliance Infocomm
- Defence

### INTERNATIONAL EPICS

- ABB
- McDermott
- VA Tech Hydro and VA Tech Flowel
- SIEMENS
- Mitsui
- Doosan
- SAMSUNG
- Itochu
- Hyundai
- LG
- Puri Llyods
- EIL
- TOYO
- BHEL
- Bechtel
- TECHNIP
- Larsen and Toubro
- TICB
- PETROFAC
- Skanska
- Alstom / Areva
- Briggs and Burton

### GLOBAL SUPPLIES

- Ireland Blyth Ltd., Mauritius
- 400 KV Switchyard Project Stage-1
- Industrial Pumps, Philippines
- Rey and Lenferna Ltd., Mauritius
- Baji Iraq
- BK Overseas, Uganda
- Bahri and Mazroeil Trading Co., U.A.E
- Gulf Incon Doha, Qatar
- Joba Trading
- Abu Dhabi Commercial Corporation, U.A.E
- Oman Cable Industry, Muscat, Oman

### FERROUS AND NON FERROUS METALS

- Min. of Electricity and Water, Bahrain
- Ministry of Finance, Dubai
- J Ray McDermott East Inc., Dubai
- Kuwait National Petroleum Corporation
- Cyprus Telecom Authority, Nicosia, Cyprus
- Modern Electrical, Trinidad
- Kahrama, Qatar
- Al Hamas
- Innovative Technologies, Dubai
- Qatar Petroleum
- SEWA, Sharjah
- Systems Building, Mauritius
- Sohar Aluminium, Dubai
- FEWA
- PPC Ltd., Canada

### PRIVATE PROJECTS

- IBM
- DELL
- Inox Multiplex
- Hotel Taj
- Biocon
- MICROSOFT
- ITC
- ICICI
- Asian Paints
- TCS
- CENTURY-DOMAIN
- Infosys software
- HSBC
- Jet Airways
- Balakrishna Tyres
- MOSER BAER
- Ranbaxy
- HDFC
- Sahara
- Godfrey Philips
- SAMTEL
- PVR Multiplex
- Citi Bank
- Mind Space
- Kala Academy

### POWER AND TRANSMISSION /DOMESTIC

- TATA Power
- BSES Limited
- Gujarat State Energy Corporation
- Essar Power
- Nuclear Power Corporation
- National Thermal Power Co.
- Indian Railway
- State Electricity Boards
- Jindal Power
- DMRC
- CPWD/PWD
- CEB Mauritius
- Ahmedabad Electricity Co. Ltd.
- Crompton and Greaves
- Power Grid Corporation
- Surat Electricity Co.Ltd.
- JSPL
- ENRON
- Karnataka Power Co. Ltd.
- JVSL
- NDPL
- GEB
- BESCOM
- MSEB
- GOA Board

## PRODUCT RANGE

KEI has been a pioneer in design and manufacture of high-performance cables and wires. Its vast portfolio ,apart from EHV cables up to 400 kV. MV (medium voltage) and HT cables also includes control and instrumentation cables, rubber cables, thermocouple cables, zero halogen cables, braided cables, single and multi core flexible cables, housewire and stainless steel wires. By actively responding to changing customer demands and expectations, the company has expanded its distribution network and strengthened existing industrial product vertical.

- EHV Cables up to 400 kV
- HTCablesupto33kV-DryCuredProcess
- LT Power Cables-Copper/Aluminium Conductor PVC, XLPE & EPR
- LT Control Cables-CopperPVC,XLPE&EPR
- Screened/Unscreened Type PVC/PE/EPR/XLPE Instrumentation Cables
- Thermocouple Compensating & Extension Cables
- Flexible & Housewires (Single & Multi core)
- Elastomeric (Rubber) Cables
- Railway Signaling Cables
- Fire Survival, Zero Halogen Cables
- Telephone Cables
- Automation Cables
- Welding Cables
- Submersible Cables/Winding Cables
- Ship Wiring Cable
- Mining Cable
- Cables for Offshore Installation
- Cables for Defence
- AB Cables
- Solar Cables

& MORE AS PER CUSTOMER SPECIFICATIONS  
IN BS, VDE, IEC, IS AND SABS STANDARDS  
(UPTO AND INCLUDING 400kV)



## MV XLPE INSULATED ARMOURED CABLES



**Application** Power cables for medium voltage (upto 33KV) are used in – outdoor cable ducts, cable trays, conduits or underground locations under mechanical stresses in power and switching stations, local distribution systems and industrial plants

Standards.	BS 6622 & IEC 60502-2
Operating temperature	90°C
Short circuit temperature	250°C
Cable range manufactured	19/33 KV Screened Cables (33 KV Earth) 12.7/22 KV Screened Cables (22 KV Earth) 11/11 KV i.e. 11 KV (UE) Screened Cables 6.6/6.6 KV Screened Cables [6.6 KV (UE) & 11 KV (E)] 3.8/6.6 KV Screened Cables 3.3 KV (E) and (UE) Unscreened / Screened Cables
Sizes	50 Sq.mm to 1000 Sq.mm in Single Core Cables 25 Sq.mm to 400 Sq.mm in Multi Cores Cables

Test Voltage	Rated Voltage	Test Voltage (for 5 min.)
Uo KV	RMS	
3.8	11	
6.35	15	
8.7	22	
12.7	30	
19	45	

### CONSTRUCTION

**Conductor** Aluminium / Annealed Plain Copper Stranded compacted circular conductor conform to BS 6360 and IEC 60228, class 2

**Conductor Screening** Semi-Conducting layer over conductor

**Insulation** Cross linked Polyethylene to (XLPE)

**Insulation Screening** Semi-Conducting layer over insulation, in combination with Copper tape.

**Core colour** Single Core – Natural  
Multi Core – Numbered or colour polyester tapes applied over Copper tapes

**Bedding** Extruded PVC

**Armour** Single Core - Non-magnetic (Aluminium) wire / Flat wire Multi core - Galvanised steel wire / Flat wire / Tape

**Outer Sheath** Extruded PVC / Special PVC compound such as Flame Retardant (FR), Flame Retardant Low Smoke (FRLS), Low Smoke Zero Halogen (LSOH) can be used for outer sheath to suit a variety of environment and fire risk conditions. Flammability test confirms to IEC 332. For installation where fire and associated problems such as emission of smoke and toxic fumes offer a serious potential threat, special LSF (Low smoke & fumes) compound can be provided. LSF compound is Halogen free (Flourine, Chlorine, Bromine) when tested as per BS 6425 (Pt 1) & IEC 60754 (Pt 1). The acid gas evolved during combustion is less than 0.5% by weight of material.

### Cables Construction

#### IEC 60502-2 3/6.6 KV Single Core Alu. Wire Armoured

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. thickness of bedding <b>mm</b>	Nominal Alu. armour wire diameter <b>mm</b>	Nominal Thickness of PVC outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Cu. cable weight <b>Kg/Km</b>	Approx. Alu. cable weight <b>Kg/Km</b>
50	2.5	0.9	1.6	1.8	25	1020	717
70	2.5	0.9	1.6	1.8	27	1247	827
95	2.5	1.0	1.6	1.8	29	1530	974
120	2.5	1.0	1.6	1.9	31	1832	1119
150	2.5	1.0	1.6	1.9	32	2112	1214
185	2.5	1.1	1.6	2.0	34	2504	1408
240	2.6	1.1	2.0	2.1	38	3171	1751
300	2.8	1.2	2.0	2.2	41	3828	2054
400	3.0	1.2	2.0	2.3	44	4846	2443
500	3.2	1.3	2.5	2.5	49	6031	3064
630	3.2	1.4	2.5	2.6	53	7351	3653
800	3.2	1.5	2.5	2.8	58	9082	4397
1000	3.2	1.6	2.5	2.9	64	11095	5261

#### IEC 60502-2 6/10 KV Single Core Alu. Wire Armoured

50	3.4	1.0	1.6	1.8	27	1121	819
70	3.4	1.0	1.6	1.8	29	1348	928
95	3.4	1.0	1.6	1.9	31	1639	1084
120	3.4	1.0	1.6	1.9	33	1934	1221
150	3.4	1.1	1.6	2.0	35	2312	1413
185	3.4	1.1	2.0	2.0	37	2692	1596
240	3.4	1.1	2.0	2.1	39	3277	1858
300	3.4	1.2	2.0	2.2	42	3909	2135
400	3.4	1.2	2.0	2.3	45	4907	2504
500	3.4	1.3	2.5	2.5	49	6079	3112
630	3.4	1.4	2.5	2.6	53	7403	3705
800	3.4	1.5	2.5	2.8	58	9139	4454
1000	3.4	1.6	2.5	3.0	64	11188	5354

#### IEC 60502-2 8.7/15 KV Single Core Alu. Wire Armoured

50	4.5	1.0	1.6	1.8	30	1257	955
70	4.5	1.0	1.6	1.9	31	1495	1075
95	4.5	1.1	1.6	1.9	33	1796	1241
120	4.5	1.1	2.0	2.0	36	2107	1394
150	4.5	1.1	2.0	2.1	36	2412	1513
185	4.5	1.1	2.0	2.1	39	2809	1713
240	4.5	1.2	2.0	2.2	42	3473	2054
300	4.5	1.2	2.0	2.3	44	4115	2341
400	4.5	1.3	2.5	2.4	49	5299	2896
500	4.5	1.4	2.5	2.6	52	6366	3399
630	4.5	1.4	2.5	2.7	56	7688	3990
800	4.5	1.5	2.5	2.8	61	9421	4737
1000	4.5	1.6	2.5	3.0	67	11495	5661



## Cables Constructions

**IEC 60502-2 12/20 KV Single Core Alu. Wire Armoured**

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. thickness of bedding <b>mm</b>	Nominal Alu. armour wire diameter <b>mm</b>	Nominal Thickness of PVC outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Cu cable weight <b>Kg/Km</b>	Approx. Alu. cable weight <b>Kg/Km</b>
50	5.5	1.0	1.6	1.9	32	1382	1080
70	5.5	1.1	1.6	2.0	35	1731	1312
95	5.5	1.1	2.0	2.0	36	2023	1468
120	5.5	1.1	2.0	2.1	39	2357	1643
150	5.5	1.2	2.0	2.1	40	2662	1764
185	5.5	1.2	2.0	2.2	42	3076	1980
240	5.5	1.2	2.0	2.3	44	3685	2266
300	5.5	1.3	2.0	2.3	48	4442	2668
400	5.5	1.3	2.5	2.5	51	5497	3095
500	5.5	1.4	2.5	2.6	54	6566	3598
630	5.5	1.5	2.5	2.8	59	7948	4250
800	5.5	1.6	2.5	2.9	63	9703	5018
1000	5.5	1.7	2.5	3.1	69	11785	5951

**IEC 60502-2 18/30 KV Single Core Alu. Wire Armoured**

50	8.0	1.1	2.0	2.1	39	1839	1536
70	8.0	1.2	2.0	2.2	41	2131	1711
95	8.0	1.2	2.0	2.2	43	2440	1885
120	8.0	1.2	2.0	2.3	45	2794	2080
150	8.0	1.3	2.0	2.3	47	3239	2340
185	8.0	1.3	2.5	2.4	49	3672	2576
240	8.0	1.3	2.5	2.5	51	4322	2902
300	8.0	1.4	2.5	2.6	54	5000	3226
400	8.0	1.4	2.5	2.7	57	6062	3659
500	8.0	1.5	2.5	2.8	60	7164	4197
630	8.0	1.6	2.5	2.9	65	8558	4859
800	8.0	1.7	2.5	3.1	69	10384	5699
1000	8.0	1.8	2.5	3.3	75	12522	6688



## Cables Constructions

**IEC 60502-2 3.6/6 KV Three Core Flat Strip Armoured**

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. thickness of bedding <b>mm</b>	Nominal Dimension G.I. Flat Strip. <b>mm</b>	Nominal Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Copper cable weight <b>Kg/Km</b>	Approx. Alu. cable weight <b>Kg/Km</b>
35	2.5	1.2	4 X 0.8	2.2	42	2790	2168
50	2.5	1.2	4 X 0.8	2.3	44	3365	2455
70	2.5	1.4	4 X 0.8	2.4	48	4108	2850
95	2.5	1.4	4 X 0.8	2.5	52	5049	3359
120	2.5	1.4	4 X 0.8	2.6	57	6037	3903
150	2.5	1.6	4 X 0.8	2.7	59	6984	4294
185	2.5	1.6	4 X 0.8	2.9	63	8230	4941
240	2.6	1.6	4 X 0.8	3.0	69	10237	5987
300	2.8	1.8	4 X 0.8	3.2	75	12361	7050
400	3.0	1.8	4 X 0.8	3.5	83	15632	8438

**IEC 60502-2 6/10 KV Three Core Flat Strip Armoured**

35	3.4	1.4	4 X 0.8	2.3	46	3186	2564
50	3.4	1.4	4 X 0.8	2.4	48	3709	2799
70	3.4	1.4	4 X 0.8	2.6	52	4526	3269
95	3.4	1.4	4 X 0.8	2.7	56	5495	3804
120	3.4	1.6	4 X 0.8	2.8	61	6566	4431
150	3.4	1.6	4 X 0.8	2.9	63	7451	4762
185	3.4	1.6	4 X 0.8	3.0	67	8720	5431
240	3.4	1.6	4 X 0.8	3.2	73	10632	6383
300	3.4	1.8	4 X 0.8	3.3	78	12646	7336
400	3.4	1.8	4 X 0.8	3.5	85	15951	8757

**IEC 60502-2 8.7/15 KV Three Core Flat Strip Armoured**

50	4.5	1.4	4 X 0.8	2.6	54	4184	3275
70	4.5	1.6	4 X 0.8	2.7	58	5080	3822
95	4.5	1.6	4 X 0.8	2.8	62	6058	4367
120	4.5	1.6	4 X 0.8	2.9	66	7134	5001
150	4.5	1.6	4 X 0.8	3.0	68	8027	5338
185	4.5	1.6	4 X 0.8	3.2	73	9362	6073
240	4.5	1.8	4 X 0.8	3.3	78	11348	7099
300	4.5	1.8	4 X 0.8	3.5	83	13369	8059
400	4.5	1.8	4 X 0.8	3.7	90	16707	9513

**IEC 60502-2 12/20 KV Three Core Flat Strip Armoured**

50	5.5	1.6	4 X 0.8	2.8	59	4717	3807
70	5.5	1.6	4 X 0.8	2.9	62	5593	4336
95	5.5	1.6	4 X 0.8	3.0	66	6601	4910
120	5.5	1.6	4 X 0.8	3.1	71	7711	5577
150	5.5	1.6	4 X 0.8	3.2	73	8614	5925
185	5.5	1.8	4 X 0.8	3.3	77	10016	6727
240	5.5	1.8	4 X 0.8	3.5	83	12011	7762
300	5.5	1.8	4 X 0.8	3.6	88	14028	8718
400	5.5	1.8	4 X 0.8	3.9	95	17457	10263

**IEC 60502-2 18/30 KV Three Core Flat Strip Armoured**

50	8.0	1.6	4 X 0.8	3.1	71	
----	-----	-----	---------	-----	----	--

## Cables Constructions

### IEC 60502-2 3.6/6 KV Three Core RWA Cable

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. thickness of bedding <b>mm</b>	Nominal G.I. Armour wire diameter <b>mm</b>	Nominal Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Copper cable weight <b>Kg/Km</b>	Approx. Alu. cable weight <b>Kg/Km</b>
35	2.5	1.2	2.0	2.3	45	3457	2835
50	2.5	1.2	2.5	2.4	48	4425	3515
70	2.5	1.4	2.5	2.5	52	5270	4013
95	2.5	1.4	2.5	2.7	56	6314	4624
120	2.5	1.4	2.5	2.8	60	7419	5285
150	2.5	1.6	2.5	2.9	63	8395	5706
185	2.5	1.6	2.5	3.0	67	9753	6464
240	2.6	1.6	2.5	3.2	73	11933	7685
300	2.8	1.8	3.15	3.4	80	14957	9647
400	3.0	1.8	3.15	3.7	88	18529	11336

### IEC 60502-2 6/10 KV Three Core RWA Cable

35	3.4	1.4	2.5	2.4	49	4271	3649
50	3.4	1.4	2.5	2.5	51	4758	3849
70	3.4	1.4	2.5	2.7	55	5677	4419
95	3.4	1.4	2.5	2.8	59	6757	5067
120	3.4	1.6	2.5	2.9	64	7936	5801
150	3.4	1.6	2.5	3.0	66	8871	6181
185	3.4	1.6	2.5	3.1	70	10214	6925
240	3.4	1.6	3.15	3.3	77	13045	8797
300	3.4	1.8	3.15	3.5	82	15257	9946
400	3.4	1.8	3.15	3.7	89	18796	11603

### IEC 60502-8.7/15 KV Three Core RWA Cable

50	4.5	1.4	2.5	2.7	57	5475	4565
70	4.5	1.6	2.5	2.8	61	6448	5190
95	4.5	1.6	2.5	3.0	65	7557	5866
120	4.5	1.6	2.5	3.1	70	8728	6594
150	4.5	1.6	2.5	3.2	72	9673	6983
185	4.5	1.6	3.15	3.3	77	11852	8563
240	4.5	1.8	3.15	3.5	84	14074	9825
300	4.5	1.8	3.15	3.6	88	16225	10914
400	4.5	1.8	3.15	3.9	95	19864	12670

### IEC 60502- 12/20 KV Three Core RWA Cable

50	5.5	1.6	2.5	2.9	62	6125	5215
70	5.5	1.6	2.5	3.0	66	7079	5821
95	5.5	1.6	2.5	3.1	70	8188	6497
120	5.5	1.6	2.5	3.2	75	9389	7254
150	5.5	1.6	3.15	3.4	78	11139	8449
185	5.5	1.8	3.15	3.5	83	12706	9417
240	5.5	1.8	3.15	3.6	88	14866	10618
300	5.5	1.8	3.15	3.8	93	17090	11780
400	5.5	1.8	3.15	4.0	100	20740	13545

### IEC 60502- 18/30 KV Three Core RWA Cable

50	8.0	1.6	2.5	3.3	75	7892	6982
70	8.0	1.8	3.15	3.4	80	9795	8536
95	8.0	1.8	3.15	3.5	84	11071	9381
120	8.0	1.8	3.15	3.6	89	12416	10282
150	8.0	1.8	3.15	3.7	90	13384	10695
185	8.0	1.8	3.15	3.9	95	15011	11722
240	8.0	1.8	3.15	4.0	101	17212	12963
300	8.0	2.0	3.15	4.2	106	19675	14364
400	8.0	2.0	3.15	4.4	113	23302	16109

## Cables Constructions

### BS6622 3.8/6.6 KV Single Core Cu/ XLPE/Alu. Wire / PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Minimum thickness of bedding <b>mm</b>	Nominal armour wire diameter <b>mm</b>	Min. Thickness of PVC outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max.DC Resistance at 20°C <b>Ohm/Km</b>
50	2.5	0.76	1.6	1.24	24.2	1090	0.387
70	2.5	0.76	1.6	1.24	25.8	1340	0.268
95	2.5	0.76	1.6	1.32	27.7	1660	0.193
120	2.5	0.76	1.6	1.32	29.8	1970	0.153
150	2.5	0.76	1.6	1.40	30.7	2260	0.124
185	2.5	0.76	2.0	1.40	33.4	2760	0.0991
240	2.6	0.76	2.0	1.48	36.4	3430	0.0754
300	2.8	0.76	2.0	1.56	39.0	4130	0.0601
400	3.0	0.76	2.0	1.64	42.6	5080	0.0470
500	3.2	0.84	2.5	1.80	47.7	6490	0.0366
630	3.2	0.92	2.5	1.88	51.5	8030	0.0283
800	3.2	0.92	2.5	1.96	56.1	9930	0.0221
1000	3.2	1.00	2.5	2.12	61.9	12200	0.0176

### 6.35/11KV Single Core Cu/ XLPE/Alu. Wire / PVC

50	3.4	0.76	1.6	1.24	26.2	1200	0.387
70	3.4	0.76	1.6	1.32	28.0	1470	0.268
95	3.4	0.76	1.6	1.32	29.7	1780	0.193
120	3.4	0.76	1.6	1.40	32.0	2110	0.153
150	3.4	0.76	2.0	1.48	33.7	2500	0.124
185	3.4	0.76	2.0	1.48	35.6	2920	0.0991
240	3.4	0.76	2.0	1.56	38.3	3580	0.0754
300	3.4	0.76	2				

## MV XLPE Insulated Armoured Cables

### 19/33 KV Single Core Cu/ XLPE/Alu. Wire / PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Minimum Thickness of bedding <b>mm</b>	Nominal armour wire diameter <b>mm</b>	Min. Thickness of PVC outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max.DC Resistance at 20°C <b>Ohm/Km</b>
50	8.0	0.76	2.0	1.56	38.7	2100	0.387
70	8.0	0.76	2.0	1.56	40.3	2390	0.268
95	8.0	0.76	2.0	1.64	42.2	2770	0.193
120	8.0	0.76	2.0	1.64	44.3	3130	0.153
150	8.0	0.84	2.5	1.72	46.4	3630	0.124
185	8.0	0.84	2.5	1.80	48.5	4110	0.0991
240	8.0	0.84	2.5	1.80	51.0	4810	0.0754
300	8.0	0.92	2.5	1.88	53.2	5540	0.0601
400	8.0	0.92	2.5	1.96	56.4	6560	0.0470
500	8.0	1.00	2.5	2.04	59.8	7830	0.0366
630	8.0	1.00	2.5	2.12	63.6	9460	0.0283
800	8.0	1.08	2.5	2.28	68.6	11520	0.0221
1000	8.0	1.16	2.5	2.36	74.2	13900	0.0176

### 3.8/6.6 KV Three Core Cu/ XLPE/ SWA / PVC

25	2.5	0.76	2.0	1.56	40.2	3330	0.727
35	2.5	0.76	2.0	1.64	42.5	3850	0.524
50	2.5	0.84	2.5	1.80	46.5	4900	0.387
70	2.5	0.84	2.5	1.88	50.2	5880	0.268
95	2.5	0.92	2.5	1.96	54.2	7090	0.193
120	2.5	1.00	2.5	2.04	59.2	8360	0.153
150	2.5	1.00	2.5	2.12	60.9	9300	0.124
185	2.5	1.08	2.5	2.20	65.4	10900	0.0991
240	2.6	1.16	2.5	2.36	72.0	13430	0.0754
300	2.8	1.24	3.15	2.60	79.3	16950	0.0601
400	3.0	1.40	3.15	2.76	87.5	20480	0.0470

### 6.35/11 KV Three Core Cu/ XLPE/ SWA / PVC

25	3.4	0.84	2.5	1.72	46.1	4330	0.727
35	3.4	0.84	2.5	1.80	48.4	4880	0.524
50	3.4	0.92	2.5	1.88	51.2	5540	0.387
70	3.4	0.92	2.5	1.96	54.9	6550	0.268
95	3.4	1.00	2.5	2.04	58.9	7800	0.193
120	3.4	1.08	2.5	2.20	64.1	9150	0.153
150	3.4	1.08	2.5	2.28	65.8	10100	0.124
185	3.4	1.16	2.5	2.36	70.3	11700	0.0991
240	3.4	1.24	3.15	2.52	77.6	15020	0.0754
300	3.4	1.32	3.15	2.68	82.5	17010	0.0601
400	3.4	1.40	3.15	2.84	89.6	21040	0.0470

### 8.7/15 KV Three Core Cu/ XLPE/ SWA / PVC

25	4.5	0.92	2.5	1.88	52.1	5200	0.727
35	4.5	0.92	2.5	1.96	54.4	5690	0.524
50	4.5	1.00	2.5	2.04	57.2	6470	0.387
70	4.5	1.00	2.5	2.12	60.9	7420	0.268
95	4.5	1.08	2.5	2.20	64.9	8720	0.193
120	4.5	1.16	2.5	2.28	69.9	10080	0.153
150	4.5	1.16	2.5	2.36	71.6	11170	0.124
185	4.5	1.24	3.15	2.52	77.6	13660	0.0991
240	4.5	1.32	3.15	2.68	83.6	16360	0.0754
300	4.5	1.40	3.15	2.76	88.3	18870	0.0601
400	4.5	1.48	3.15	3.00	95.6	22290	0.0470

## Cables Constructions

### 12.7/22 KV Three Core Cu/ XLPE/SWA/ PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Minimum Thickness of bedding <b>mm</b>	Nominal armour wire diameter <b>mm</b>	Min. Thickness of PVC outer sheath <b>mm</b>	Approx. over all diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max.DC Resistance at 20°C <b>Ohm/Km</b>
35	5.5	1.00	2.50	2.04	60.9	6440	0.524
50	5.5	1.00	2.50	2.12	63.5	7150	0.387
70	5.5	1.08	2.50	2.20	67.3	8280	0.268
95	5.5	1.16	2.50	2.36	71.6	9630	0.193
120	5.5	1.16	3.15	2.44	77.6	11930	0.153
150	5.5	1.24	3.15	2.52	79.5	12930	0.124
185	5.5	1.32	3.15	2.68	84.2	14750	0.0991
240	5.5	1.40	3.15	2.76	90.0	17210	0.0754
300	5.5	1.40	3.15	2.92	94.8	19720	0.0601
400	5.5	1.56	3.15	3.08	102.0	23140	0.0470

### 19/33 KV Three Core Cu/ XLPE/ SWA / PVC

50	8.0	1.24	3.15	2.60	82.1	11870	0.268
95	8.0	1.32	3.15	2.68	86.2	13380	0.193
120	8.0	1.40	3.15	2.76	91.1	14940	0.153
150	8.0	1.40	3.15	2.84	92.8	16170	0.124
185	8.0	1.48	3.15	2.92	97.3	18050	0.0991
240	8.0	1.56	3.15	3.08	103.3	20810	0.0754
300	8.0	1.64	3.15	3.24	108.3	23480	0.0601
400	8.0	1.72	3.15	3.40	115.3	27150	0.0470

Impulse Testing Lab



Conductor Technical Data for single Core and Multicore cables conforming to IEC 60228 (Stranded-Class-2) Aluminium Conductors and annulled copper conductors, stranded circular, compacted circular or shaped

Table -1

Nominal size of	Short Circuit Rating (ISC) for XLPE cables		Max. D.C. Resistance at 20°C		Max. A.C. Resistance at 90°C	
Conductor	Copper	Aluminium	Plain Copper	Aluminium	Plain Copper	Aluminium
mm <sup>2</sup>	KA/sec	KA/sec	Ω/Km	Ω/Km	Ω/Km	Ω/Km
1.5	0.21	-	12.200	-	15.430	-
2.5	0.36	-	7.410	-	9.450	-
4.0	0.57	0.38	4.610	7.410	5.880	9.480
6.0	0.85	0.56	3.080	4.610	3.930	5.900
10	1.42	0.94	1.830	3.080	2.330	3.490
16	2.27	1.50	1.150	1.910	1.470	2.420
25	3.60	2.40	0.727	1.200	0.930	1.540
35	5.00	3.30	0.524	0.868	0.671	1.110
50	7.10	4.70	0.387	0.641	0.495	0.820
70	10.0	6.60	0.268	0.443	0.343	0.567
95	13.6	9.00	0.193	0.320	0.247	0.410
120	17.1	11.3	0.153	0.253	0.196	0.324
150	21.4	14.2	0.124	0.206	0.159	0.264
185	26.4	17.5	0.0991	0.164	0.127	0.210
240	34.3	22.6	0.0754	0.125	0.0965	0.160
300	42.9	28.3	0.0601	0.100	0.0769	0.130
400	57.1	37.7	0.0470	0.0778	0.0602	0.100
500	71.4	47.2	0.0366	0.0605	0.0468	0.0774
630	90.0	59.4	0.0283	0.0469	0.0362	0.0600
800	114.3	75.5	0.0221	0.0367	0.0283	0.0470
1000	142.9	94.3	0.0176	0.0291	0.0225	0.0372

#### Short Circuit Current Ratings for XLPE Cables

Short Circuit Rating for 1 second duration for Copper and Aluminium XLPE Cables (Isc Current in KAmps)

#### Ratings for any other duration :

- 1) Max. Initial Conductor Temperature during operation : 90°C
- 2) Max. Final Conductor Temperature during short circuit : 250°C

Formula relating short Circuit Rating with t second duration

$$1t = 1sc/\sqrt{t}$$

Where 1t = Short Circuit Rating for t seconds.

t = Duration in seconds.

1sc = Short Circuit rating for 1 second.

Emergency overload : Cable may operate under overload conditions. Under such condition conductor temperature not to exceed 130°C for maximum 100 hours per year and not more than 500 hours during lifetime of cable. This is approximately 20% higher than specified rated current during the emergency period.



#### Current ratings for single core cable with XLPE insulation

Nominal area of conductor	Rated Voltage 3.6/6 KV to 18/30 KV Copper Conductor						
	Buried direct in the ground 20°C		In single-way ducts 20°C		In Air 30°C		
	Trefoil	Flat spaced	Trefoil	Flat touching ducts	Trefoil	Flat touching	Flat spaced
mm <sup>2</sup>	A	A	A	A	A	A	A
16	109	113	103	104	125	128	150
25	140	144	132	133	163	167	196
35	166	172	157	159	198	203	238
50	196	203	186	188	238	243	286
70	239	246	227	229	296	303	356
95	285	293	271	274	361	369	434
120	323	332	308	311	417	426	500
150	361	366	343	347	473	481	559
185	406	410	387	391	543	550	637
240	469	470	447	453	641	647	745
300	526	524	504	510	735	739	846
400	590	572	564	571	845	837	938
500	650	710	-	-	950	-	1090
630	730	790	-	-	1070	-	1260
800	820	910	-	-	1200	-	1410
1000	930	1030	-	-	1360	-	1610

Maximum conductor temperature

90°C

Ambient air temperature

30°C

Ground temperature

20°C

Depth of laying

0.8 m


Thermal resistivity of soil

1.5 K.m/W

Thermal resistivity of earthenware ducts

1.2 k.m/W

Screens bonded at both ends.

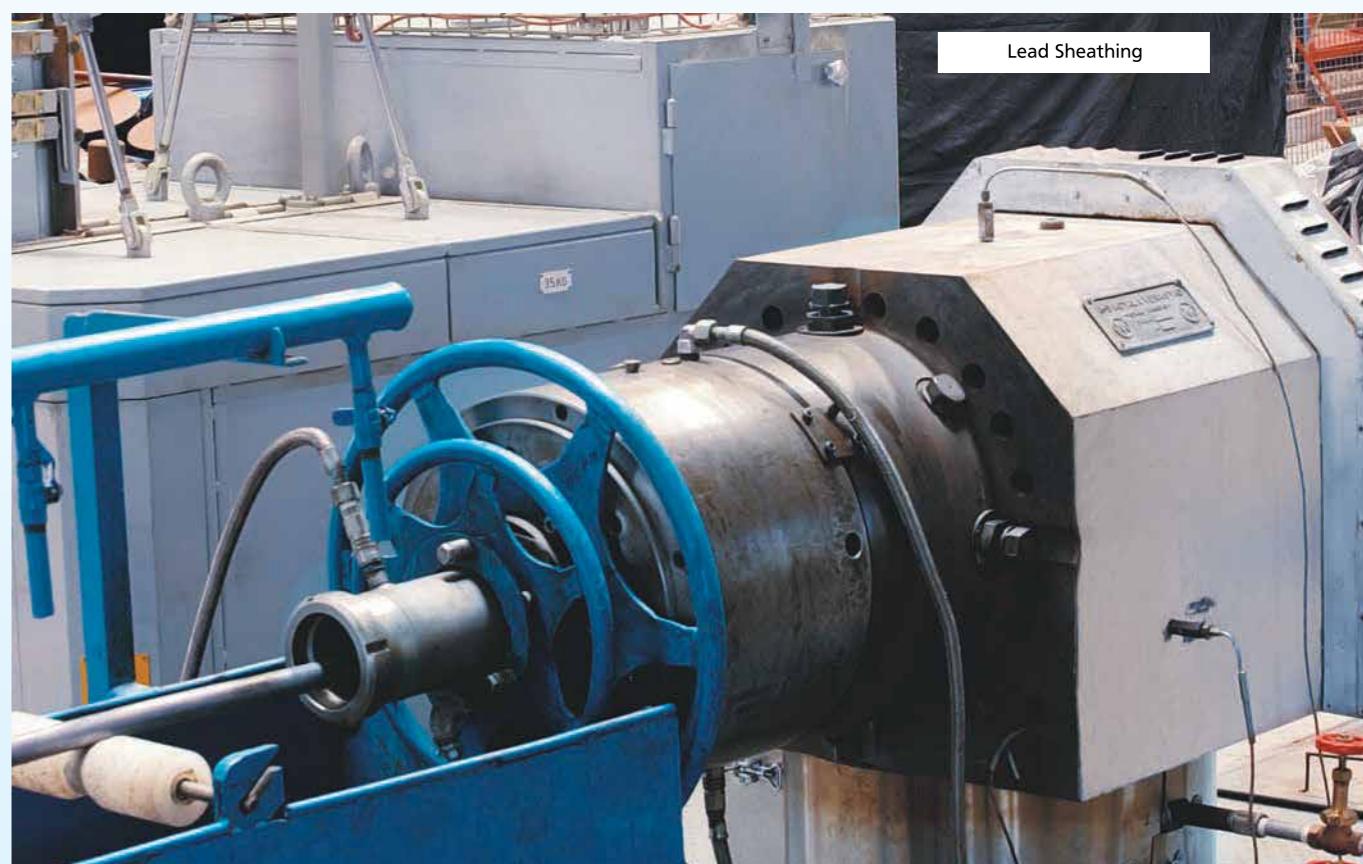

## Current ratings for single-core cables with XLPE insulation-rated voltage 3.6/6 KV to 18/30 KV

### Aluminium conductor

Nominal area of conductor  mm <sup>2</sup>	Buried direct in the ground 20°C		In single-way ducts 20°C		In Air 30°C		
	Trefoil	Flat spaced	Trefoil Ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
16	84	88	80	81	97	99	116
25	108	112	102	103	127	130	153
35	129	134	122	123	154	157	185
50	152	157	144	146	184	189	222
70	186	192	176	178	230	236	278
95	221	229	210	213	280	287	338
120	252	260	240	242	324	332	391
150	281	288	267	271	368	376	440
185	317	324	303	307	424	432	504
240	367	373	351	356	502	511	593
300	414	419	397	402	577	586	677
400	470	466	451	457	673	676	769
500	520	560	-	-	660	-	760
630	590	640	-	-	740	-	850
800	670	720	-	-	840	-	960
1000	750	800	-	-	950	-	1100

Maximum conductor temperature 90°C  
 Ambient air temperature 30°C  
 Ground temperature 20°C  
 Depth of playing 0.8 m  
 Thermal resistivity of soil 1.5 K.m/W  
 Thermal resistivity of earthenware ducts 1.2 k.m/W  
 Screens bonded at both ends.

## Current ratings for three core XLPE insulated cables rated voltage 3.6/6 KV. to 18/30 KV

### Aluminium conductor, Armoured and Unarmoured

Nominal area of conductor  mm <sup>2</sup>	Unarmoured			Armoured		
	Buried Direct in ground 20°C	In a Buried duct 20°C	In Air 30°C	Buried Direct in ground 20°C	In a Buried duct 20°C	In Air 30°C
						
16	78	67	84	78	68	85
25	100	87	110	100	87	111
35	119	103	132	119	104	133
50	140	122	158	140	123	159
70	171	150	196	171	150	196
95	203	179	236	204	180	238
120	232	205	273	232	206	274
150	260	231	309	259	231	309
185	294	262	355	293	262	354
240	340	305	415	338	304	415
300	384	346	475	380	343	472
400	438	398	552	432	393	545

Maximum conductor temperature 90°C  
 Ambient air temperature 30°C  
 Ground temperature 20°C  
 Depth of playing 0.8 m  
 Thermal resistivity of soil 1.5 K.m/W  
 Thermal resistivity of earthenware ducts 1.2 k.m/W  
 Screens bonded at both ends.

## Current ratings for three-core cables with XLPE insulation-rated voltage 3.6/6 KV to 18/30 KV

### Copper conductor Armoured and Unarmoured

Nominal area of conductor  mm <sup>2</sup>	Unarmoured			Armoured		
	Buried Direct in ground 20°C	In a Buried duct 20°C	In Air 30°C	Buried Direct in ground 20°C	In a Buried duct 20°C	In Air 30°C
						
16	101	87	109	101	88	110
25	129	112	142	129	112	143
35	153	133	170	154	134	172
50	181	158	204	181	158	205
70	221	193	253	220	194	253
95	262	231	304	263	232	307
120	298	264	351	298	264	352
150	334	297	398	332	296	397
185	377	336	455	374	335	453
240	434	390	531	431	387	529
300	489	441	606	482	435	599
400	553	501	696	541	492	683

Maximum conductor temperature 90°C  
 Ambient air temperature 30°C  
 Ground temperature 20°C  
 Depth of playing 0.8 m  
 Thermal resistivity of soil 1.5 K.m/W  
 Thermal resistivity of earthenware ducts 1.2 k.m/W  
 Screens bonded at both ends.



## XLPE INSULATED ARMOURED CABLES



- Application**
- Indoors or Outdoors in cable ducts, cable trays, conduits or underground locations under mechanical stresses in power and switching stations.
  - Local distribution systems, Industrial and Commercial units for basic power & lighting purpose.

Standards	BS 5467, IEC 60502-1& VDE 0276
Operating Temperature	90° C
Short Circuit Temp.	250° C
Working Voltage	600 / 1000 Volts
Test Voltage	3.5 KV r m s for 5 minutes

### CONSTRUCTION

**Conductor** Aluminium / Annealed plain copper solid\* / stranded conductor conform to BS 6360 and IEC 60228 Class 2 (Circular / Sector shaped)

**Insulation** Cross linked polyethylene (XLPE)

Single core	Red or Black
2 Core	Red , Black
3 Core	Red , Yellow , Blue
4 Core	Red , Yellow, Blue, Black
5 Core	Red , Yellow, Blue, Black & Yellow - Green
6 Core & above	Black colour with number printing

**Assembly** Insulated conductors are laid up together, if necessary interstices may be filled with fillers.

**Fillers** Non-hygroscopic Poly propylene fillers are included between laid up cores wherever required.

A separator tape of non-hygroscopic poly propylene material is applied over laid up core wherever necessary.

**Bedding** Extruded PVC compatible with operating temperature

**Armour** For Single Core - Aluminium round wire / flat wire. For Multicore - Galvanised Steel round wire / flat wire / tape.

**Outer Sheath** Extruded PVC / Special PVC compound such as Flame Retardant (FR), Flame Retardant Low Smoke (FRLS), Low Smoke Zero Halogen (LSOH) can be used for outer sheath to suit a variety of environment and fire risk conditions. Flammability test confirms to IEC 332 & Swidish chimeny. For installation where fire and associated problems such as emission of smoke and toxic fumes offer a serious potential threat, special LSF (Low smoke & fumes) compound can be provided. LSF compound is Halogen free (Flourine, Chlorine, Bromine) when tested as per BS 6425 (Pt 1) & IEC 60754 (Pt 1). The acid gas evolved during combustion is less than 0.5% by weight of material.

Minimum Bending radius 12 times the cable diameter

Admissible Pulling Force Aluminium - 30N/mm<sup>2</sup> Copper - 50N/mm<sup>2</sup>

### Cables Constructions

#### IEC 60502-1 0.6/1.0 KV Single Core XLPE/PVC/RWA/PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. Thickness of bedding <b>mm</b>	Nominal Alu. armour wire diameter <b>mm</b>	Nominal Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Copper Cable weight <b>Kg/Km</b>	Approx. Alu. Cable weight <b>Ohm/Km</b>
25	0.90	1.0	0.8	1.8	15.5	447	300
35	0.90	1.0	0.8	1.8	16.5	553	346
50	1.00	1.0	1.25	1.8	19.0	757	454
70	1.10	1.0	1.25	1.8	21.0	978	558
95	1.10	1.0	1.25	1.8	22.5	1,233	677
120	1.20	1.0	1.6	1.8	25.5	1,559	846
150	1.40	1.0	1.6	1.8	26.5	1,854	955
185	1.60	1.0	1.6	1.8	29.0	2,226	1,130
240	1.70	1.0	1.6	1.9	32.0	2,791	1,372
300	1.80	1.0	1.6	1.9	34.0	3,378	1,604
400	2.00	1.2	2.0	2.1	39.0	4,502	2,099
500	2.20	1.2	2.0	2.2	43.0	5,506	2,539
630	2.40	1.2	2.0	2.3	47.0	6,796	3,098
800	2.60	1.4	2.5	2.5	53.5	8,757	4,072
1000	2.80	1.4	2.5	2.7	59.5	10,782	4,948

#### IEC 60502-1 0.6/1.0 KV Two Cores XLPE/PVC/RWA/PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Approx. Thickness of bedding <b>mm</b>	Nominal G.I. armour wire diameter <b>mm</b>	Nominal thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. Copper Cable weight <b>Kg/Km</b>	Approx. Alu. Cable weight <b>Kg/Km</b>	Nominal dimension G.I. Flat Strip <b>mm</b>	Nominal thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. copper cable weight <b>Kg/Km</b>	Approx. Alu. Cable weight <b>Kg/Km</b>
1.5	0.7	1.0	0.8	1.8	14.0	325	298	4 X 0.8	1.8	19.5	936	642
2.5	0.7	1.0	0.8	1.8	15.0	372	328	4 X 0.8	1.8	21.0	1158	742
4.0	0.7	1.0	0.8	1.8	16.0	444	397	4 X 0.8	1.8	23.0	1507	901
6.0	0.7	1.0	0.8	1.8	17.0	520	446	4 X 0.8	1.9	26.0	1964	1126
10	0.7	1.0	1.25	1.8	20.0	802	680	4 X 0.8	2.0	29.0	2500	1372
16	0.7	1.0	1.25	1.8	22.0	995	807	4 X 0.8	2.1	31.5	3059	1636
25	0.90	1.0	1.60	1.8	21.0	1124	830	4 X 0.8	2.2	34.5	3713	1920
35	0.90	1.0	1.60	1.8	22.5	1367	952	4 X 0.8	2.4	38.5	4546	2353
50	1.00	1.0	1.60	1.8	24.5	1714	1107	4 X 0.8	2.6	42.0	5670	2838
70	1.10	1.0	1.60	2.0	27.5	2212	1374	4 X 0.8	2.7	46.5	6947	3407
95	1.10	1.2	2.00	2.1	31.5	2993	1865	4 X 0.8	3.0	51.5	8958	4163
120	1.20	1.2	2.00	2.2	34.5	3579	2155					
150	1.40	1.2	2.00	2.3	37.0	4282	2490					
185	1.60	1.4	2.50	2.5	42.0	5480	3287					
240	1.70	1.4	2.50	2.7	46.0	6712	3880					
300	1.80	1.6	2.50	2.8	50.0	8108	4568					
400	2.00	1.6	2.50	3.1	55.0	10204	5408					



Note : Unarmoured cables construction details available upon request.

\*Aluminium - upto 10 mm<sup>2</sup> Copper - upto 6 mm<sup>2</sup>

\*\*Modification which serve to improve our products will be implemented without notice.

## Cables Constructions

**IEC 60502-1 0.6/1.0 KV Three Cores XLPE/PVC/RWA/PVC**

Nominal cross sectional area	Nominal thickness of insulation	Nominal thickness of bedding	Approx. G.I. Thickness of armour wire	Nominal thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight	Approx. Cable weight
mm <sup>2</sup>	mm	mm	mm	mm	mm	Kg/Km	Kg/Km	mm
1.5	0.7	1.0	0.8	1.8	14.5	353	314	
2.5	0.7	1.0	0.8	1.8	15.5	411	345	
4.0	0.7	1.0	0.8	1.8	16.5	497	427	
6.0	0.7	1.0	0.8	1.8	18.0	597	486	
10	0.7	1.0	1.25	1.8	21.0	922	738	
16	0.7	1.0	1.25	1.8	23.0	1172	890	
25	0.90	1.0	1.60	1.8	23.5	1474	1032	
35	0.90	1.0	1.60	1.8	25.0	1787	1165	
50	1.00	1.0	1.60	1.9	28.5	2348	1439	
70	1.10	1.2	2.00	2.0	33.0	3252	1995	
95	1.10	1.2	2.00	2.2	36.5	4092	2401	
120	1.20	1.2	2.00	2.3	39.5	4934	2800	
150	1.40	1.4	2.50	2.5	44.5	6367	3678	
185	1.60	1.4	2.50	2.6	48.5	7608	4319	
240	1.70	1.6	2.50	2.8	53.0	9378	5130	
300	1.80	1.6	2.50	3.0	59.5	11434	6123	
400	2.00	1.6	2.50	3.2	64.5	14456	7262	

**XLPE/PVC/FSA/PVC**

Nominal dimension G.I. Flat Strip.	Nominal Thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight
mm	mm	mm	Kg/Km	Kg/Km
4 X 0.8	1.8	22.0	1258	817
4 X 0.8	1.8	23.5	1565	943
4 X 0.8	1.8	27.0	2069	1160
4 X 0.8	2.0	30.5	2774	1516
4 X 0.8	2.1	33.5	3548	1857
4 X 0.8	2.2	37.0	4340	2206
4 X 0.8	2.3	41.0	5348	2659
4 X 0.8	2.5	45.0	6465	3176
4 X 0.8	2.7	49.5	8152	3903
4 X 0.8	2.8	55.5	10009	4698
4 X 0.8	3.1	61.0	12960	5766

**IEC 60502-1 0.6/1.0 KV Four Cores with reduced Neutral XLPE/PVC/RWA/PVC**

Nominal cross sectional area	Nominal thickness of insulation	Nominal thickness of bedding	Approx. G.I. Thickness of armour wire	Nominal thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight	Approx. Cable weight
mm <sup>2</sup>	mm	mm	mm	mm	mm	Kg/Km	Kg/Km	mm
25	0.90	1.0	1.60	1.8	24.5	1652	1117	
35	0.90	1.0	1.60	1.8	26.0	1987	1270	
50	1.00	1.0	1.60	1.9	29.5	2608	1552	
70	1.10	1.2	2.00	2.1	34.5	3663	2197	
95	1.10	1.2	2.00	2.2	38.0	4653	2660	
120	1.20	1.2	2.00	2.4	41.5	5698	3145	
150	1.40	1.4	2.50	2.5	46.5	7156	4049	
185	1.60	1.4	2.50	2.7	51.5	8656	4804	
240	1.70	1.6	2.50	2.9	57.5	10769	5808	
300	1.80	1.6	2.50	3.0	61.5	12920	6713	
400	2.00	1.6	3.15	3.3	69.0	17096	8806	

**XLPE/PVC/FSA/PVC**

Nominal dimension G.I. Flat Strip.	Nominal Thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight
mm	mm	mm	Kg/Km	Kg/Km
4 X 0.8	1.8	23.0	1446	910
4 X 0.8	1.8	24.5	1758	1042
4 X 0.8	1.9	27.5	2351	1295
4 X 0.8	2.1	32.0	3159	1694
4 X 0.8	2.2	35.5	4077	2083
4 X 0.8	2.3	39.0	5088	2535
4 X 0.8	2.5	43.0	6086	2978
4 X 0.8	2.7	48.0	7467	3614
4 X 0.8	2.9	54.0	9448	4487
4 X 0.8	3.1	58.5	11547	5339
4 X 0.8	3.4	65.0	14901	6611

**IEC 60502-1 0.6/1.0 KV Four Cores XLPE/PVC/RWA/PVC**

Nominal cross sectional area	Nominal thickness of insulation	Nominal thickness of bedding	Approx. G.I. Thickness of armour wire	Nominal thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight	Approx. Cable weight
mm <sup>2</sup>	mm	mm	mm	mm	mm	Kg/Km	Kg/Km	mm
1.5	0.7	1.0	0.8	1.8	15.5	393.2	340.5	
2.5	0.7	1.0	0.8	1.8	16.5	465.8	378.6	
4.0	0.7	1.0	0.8	1.8	18.0	574.0	480.1	
6.0	0.7	1.0	1.25	1.8	20.0	828.7	680.6	
10	0.7	1.0	1.25	1.8	22.5	1076.1	832.1	
16	0.7	1.0	1.60	1.8	25.5	1525.3	1149.3	
25	0.90	1.0	1.60	1.8	25.0	1761.2	1172.2	
35	0.90	1.0	1.60	1.9	27.0	2201.1	1370.4	
50	1.00	1.0	1.60	2.0	30.5	2893.0	1680.7	
70	1.10	1.2	2.00	2.2	35.5	4033.8	2356.7	
95	1.10	1.2	2.00	2.3	39.5	5141.9	2887.4	
120	1.20	1.4	2.50	2.5	44.5	6630.8	3784.3	
150	1.40	1.4	2.50	2.6	47.5	7952.6	4367.4	
185	1.60	1.4	2.50	2.8	53.0	9565.0	5180.3	
240	1.70	1.6	2.50	3.0	59.0	11941.3	6276.7	
300	1.80	1.6	2.50	3.2	65.0	14495.5	7415.0	
400	2.00	1.8	3.15	3.5	74.0	19476.0	9883.9	


**XLPE/PVC/FSA/PVC**

Nominal dimension G.I. Flat Strip.	Nominal Thickness of outer sheath	Approx. overall diameter	Approx. Copper Cable weight	Approx. Alu. Cable weight
mm	mm	mm	Kg/Km	Kg/Km





<tbl\_r cells="5" ix="5" maxc

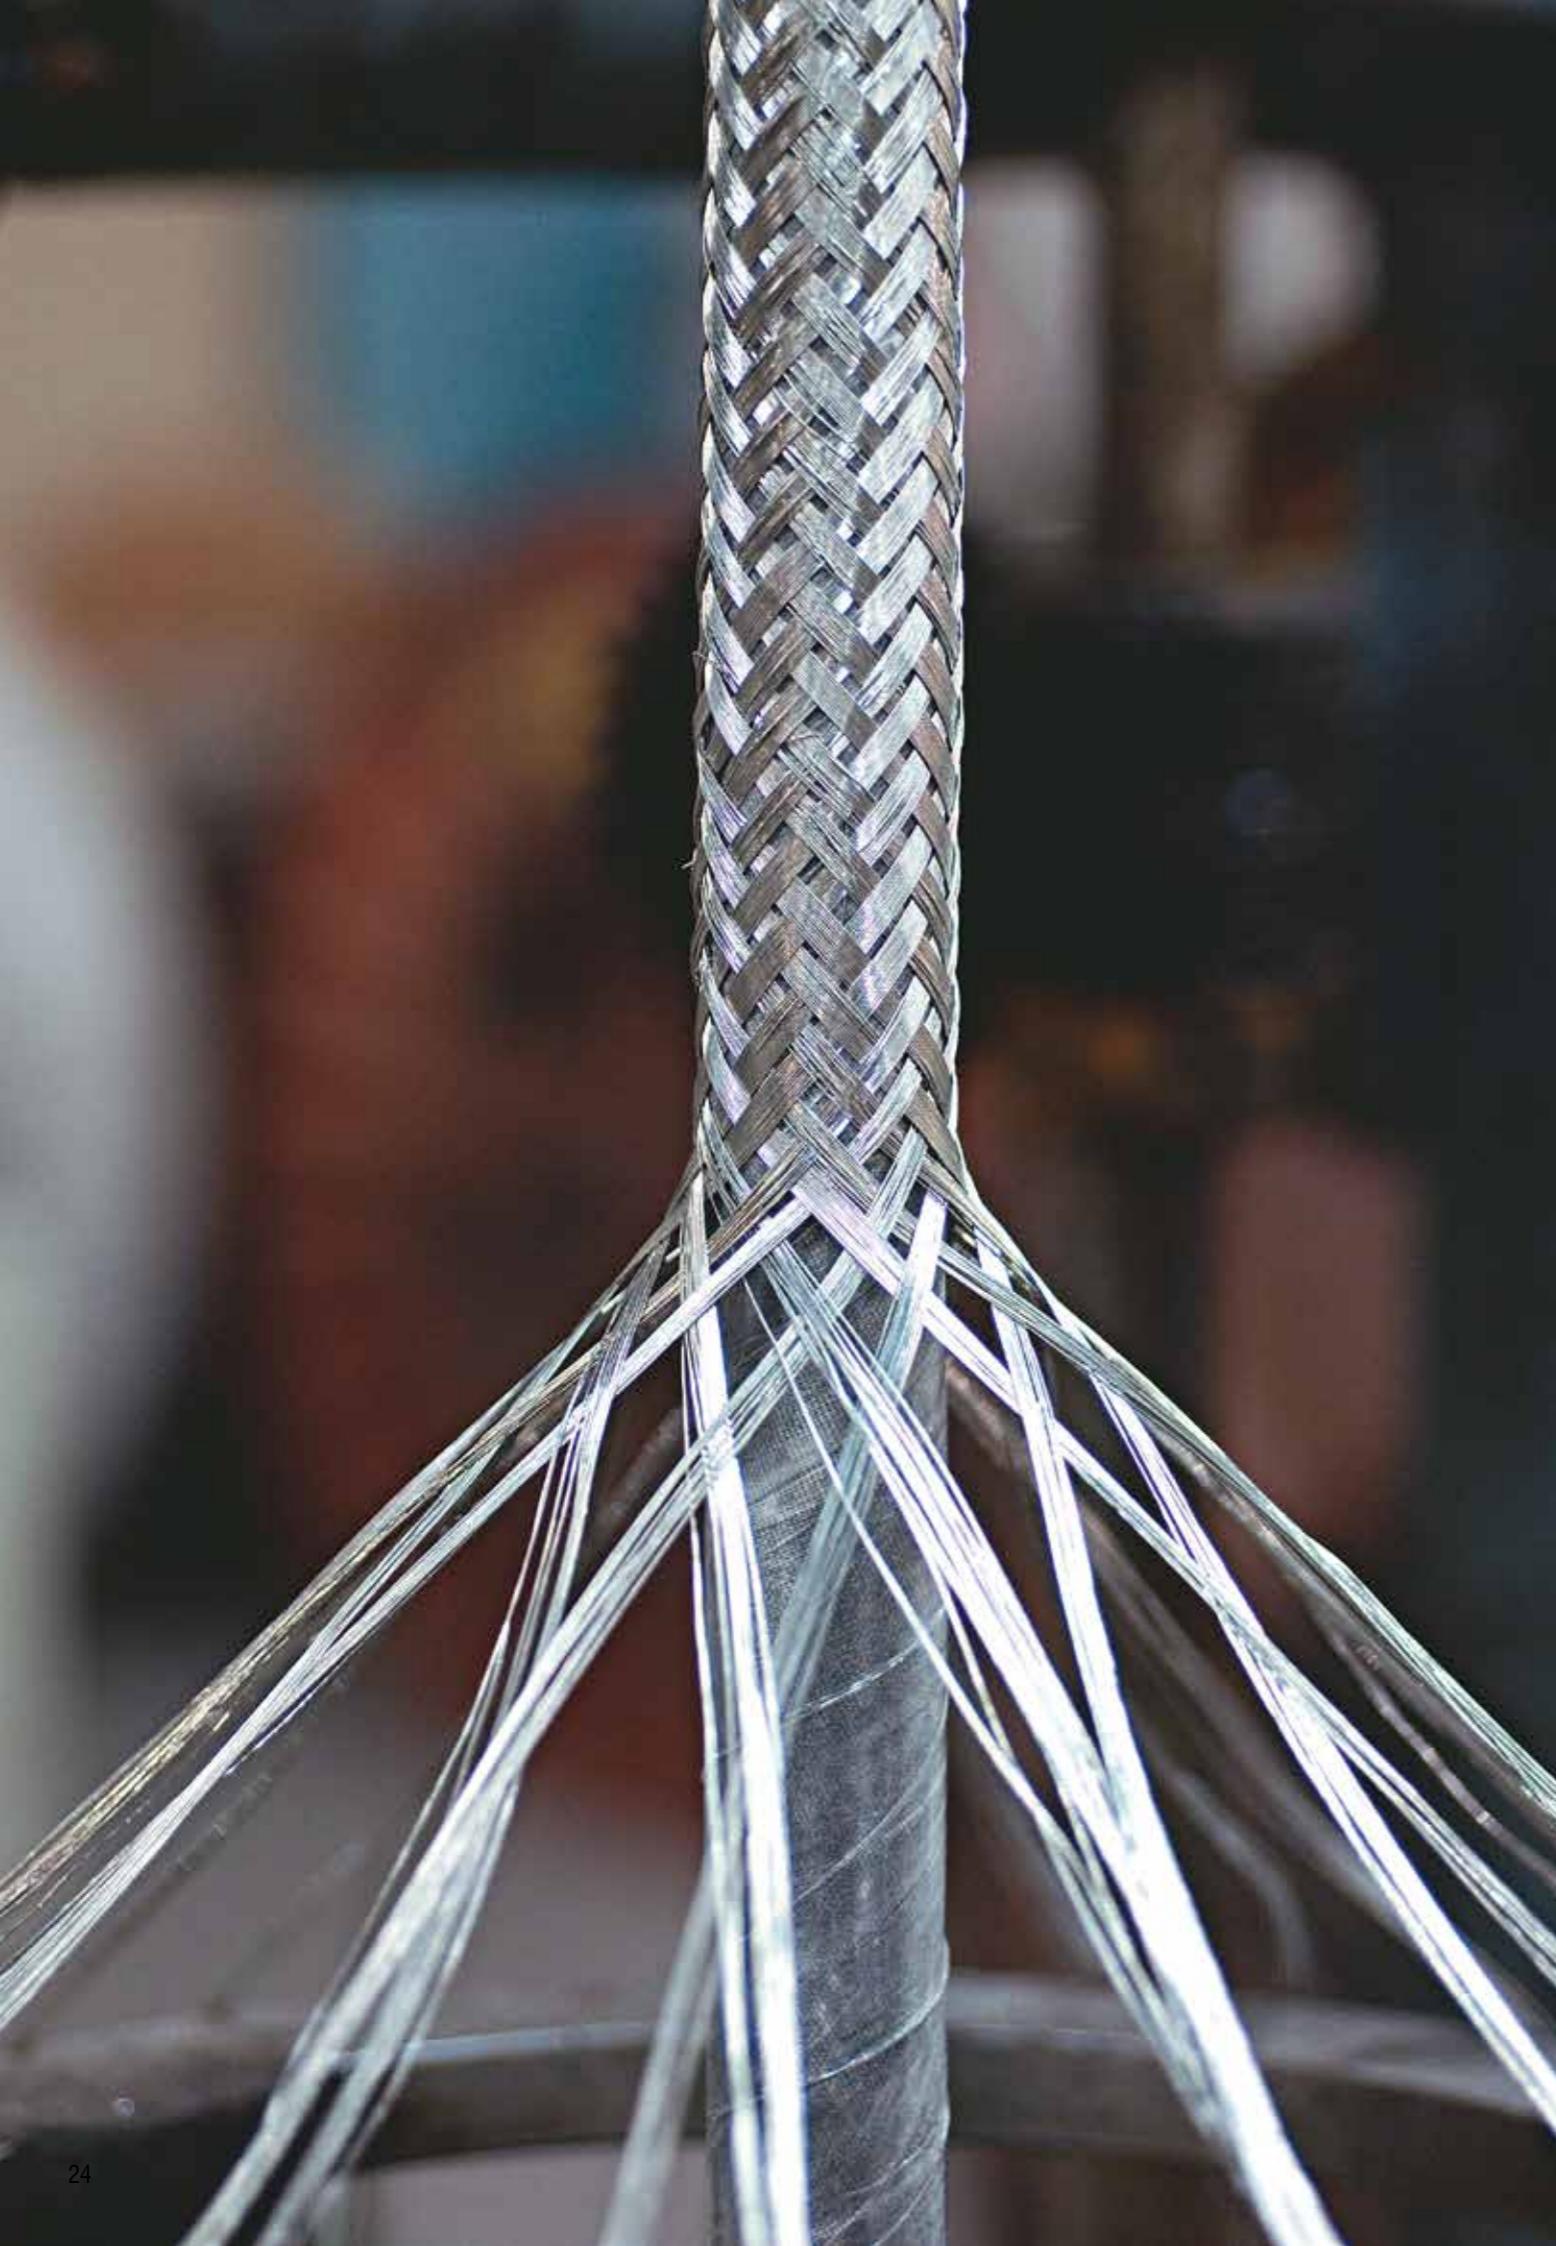

## Rating Factors

Where the conditions of installation differ from those defined in the current rating tables, the following rating factors may be used for cables size selection.

### Cables Laid Directly in Ground

Ratings for cables installed directly in the ground are based on values of soil temperature and soil thermal resistivity which are generally representative of conditions in the United Kingdom. Rating factors to take account of variation in ground temperatures are given in Table 2. Where conditions of operation can be fairly accurately estimated and knowledge of the soil along the route is available, it is possible to determine the ratings more precisely by the use of the soil thermal resistivity factors, grouping factors, and factors for the depths of laying given in Tables 3 to 6.

Table-2

Rating Factors for Ground Temperature							
Ground temperature	15°C	20°C	25°C	30°C	35°C	40°C	45°C
Cable Type	Rating factor						
XLPE Insulated	1.0	0.97	0.93	0.89	0.86	0.82	0.76

Table-3

Size of cables mm <sup>2</sup>	Soil thermal resistivity in °C m/W						
	0.8	0.9	1.0	1.5	2.0	2.5	3.0
Single core cables							
Up to 150	1.16	1.12	1.07	0.91	0.81	0.73	0.66
From 185 to 300	1.17	1.12	1.07	0.91	0.80	0.73	0.66
From 400 to 1000	1.17	1.12	1.07	0.91	0.80	0.73	0.66
Multicore cables							
Up to 16	1.12	1.08	1.05	0.93	0.84	0.77	0.72
From 25 to 150	1.14	1.10	1.06	0.92	0.82	0.75	0.69
From 185 to 500	1.15	1.10	1.07	0.92	0.81	0.74	0.67



Table - 4

**Rating Factors for Depth of Laying (To Centre of Cable or Trefoil Group of Cables)**

Depth of laying m	600/1000 Volt			1900/3300 Volt	
	Up to 50 mm <sup>2</sup>	70 mm <sup>2</sup> to 300 mm <sup>2</sup>	Above 300 mm <sup>2</sup>	Up to 300 mm <sup>2</sup>	Above 300 mm <sup>2</sup>
0.50	1.00	1.00	1.00	-	-
0.60	0.99	0.98	0.97	-	-
0.80	0.97	0.96	0.94	1.00	1.00
1.00	0.95	0.93	0.92	0.98	0.97
1.25	0.94	0.92	0.89	0.96	0.95
1.50	0.93	0.90	0.87	0.95	0.93
1.75	0.92	0.89	0.86	0.94	0.91
2.00	0.91	0.88	0.85	0.92	0.89
2.50	0.90	0.87	0.84	0.91	0.88
3.00 or more	0.89	0.85	0.82	0.90	0.86

Table - 5

**Group rating factors for circuits of three single core cables in trefoil or laid flat Touching, in horizontal formation**

Number of Circuits		Spacing of Circuits					
		Touching**					
		Trefoil	Laid flat	0.15 m*	0.30 m	0.45 m	0.60 m
600/1000 Volt cables	2	0.78	0.81	0.83	0.88	0.91	0.93
	3	0.66	0.70	0.73	0.79	0.84	0.87
	4	0.61	0.64	0.68	0.73	0.81	0.85
	5	0.56	0.60	0.64	0.73	0.79	0.85
	6	0.53	0.57	0.61	0.71	0.78	0.82
1900/3300 Volt cables	2	0.78	0.80	0.82	0.86	0.89	0.91
	3	0.66	0.68	0.71	0.77	0.80	0.83
	4	0.59	0.62	0.65	0.72	0.77	0.80
	5	0.55	0.58	0.61	0.68	0.74	0.78
	6	0.52	0.55	0.58	0.66	0.72	0.76

\* This spacing will not be possible for some of the larger diameter cables.

\*\* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits.

Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

Table - 6

**Group Rating Factors for Multicore Cables in Horizontal Formation**

Number of Cables in Group	Spacing				
	Touching**	0.15 m*	0.30 m	0.45 m	0.60 m
600/1000 Volt cables	2	0.81	0.87	0.91	0.93
	3	0.70	0.78	0.84	0.88
	4	0.63	0.74	0.81	0.86
	5	0.59	0.70	0.78	0.84
	6	0.55	0.68	0.77	0.83
1900/3300 Volt cables	2	0.80	0.85	0.89	0.91
	3	0.68	0.76	0.81	0.84
	4	0.62	0.71	0.77	0.81
	5	0.57	0.66	0.73	0.78
	6	0.54	0.64	0.71	0.77

\* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits.

Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

**Cables Installed in Ducts**

The term ducts applies to single way earthenware, fibre or ferrous pipes.

Table - 7

**Recommended Duct Dimensions and Cable Sizes**

Overall cable diameter mm	Duct	
	Inside diameter mm	Outside diameter mm
Up to and including 65	100	130
Above 65 up to and including 90	125	160

Ratings for cables installed in single way ducts, underground, have been based on values of soil temperature and soil thermal resistivity which are generally representative of conditions in the United Kingdom. Rating factors to take account of variations in ground temperatures are given in Table 2. Where conditions of operation can be fairly accurately estimated, and knowledge of the soil along the route is available, it is possible to determine the ratings more precisely by the use of estimated maximum ground temperature, the soil thermal resistivity factors, grouping factors, and factors for the depths of laying given.

**Rating Factors for Ground Temperature**

Note: Same as for direct in ground.



Table - 8

### Rating factors of variation in thermal resistivity of soil (Average Values)

Size of cable mm <sup>2</sup>	Soil thermal resistivity in °C m/W						
	0.8	0.9	1.0	1.5	2.0	2.5	3.0
Single Core Cable							
Up to 150	1.10	1.07	1.04	0.94	0.86	0.80	0.76
From 185 to 300	1.11	1.08	1.05	0.93	0.85	0.79	0.75
From 400 to 1000	1.12	1.08	1.05	0.93	0.84	0.78	0.74
Multicore Cables							
Up to 16	1.04	1.03	1.02	0.97	0.92	0.88	0.86
From 25 to 150	1.06	1.04	1.03	0.95	0.90	0.85	0.81
From 185 to 500	1.07	1.05	1.03	0.95	0.88	0.83	0.78

Table - 9

### Rating factors of depth of laying (to centre of duct or trefoil Group of ducts)

Depth in laying m	600/1000 Volt		1900/3300 Volt	
	Single Core	Multicore	Single Core	Multicore
0.50	1.00	1.00	-	-
0.60	0.98	0.99	-	-
0.80	0.95	0.98	1.00	1.00
1.00	0.93	0.96	0.98	0.99
1.25	0.91	0.95	0.95	0.97
1.50	0.89	0.94	0.93	0.96
1.75	0.88	0.94	0.92	0.95
2.00	0.87	0.93	0.90	0.94
2.50	0.86	0.92	0.89	0.93
3.00 or more	0.85	0.91	0.88	0.92

Table - 10

### Group Rating Factors for Single Core Cables in Trefoil Single Way Ducts, Horizontal Formation (Average Values)

Number of Circuits	Trefoil Formation		
	Spacing		
	Touching*	0.45 m	0.60 m
600/1000 Volt Cables	2	0.87	0.91
	3	0.78	0.84
	4	0.74	0.81
	5	0.70	0.79
	6	0.69	0.78
1900/3300 Volt Cables	2	0.85	0.88
	3	0.75	0.80
	4	0.70	0.77
	5	0.67	0.74
	6	0.64	0.72

For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

Table - 11

### Group Rating Factors for Multicore Cables in Single Way Ducts, Horizontal Formation (Average Values)

Number of Circuits	Single Way Ducts, Horizontal Formation			
	Spacing			
	Touching*	0.30 m	0.45 m	0.60 m
600/1000 Volt Cables	2	0.90	0.93	0.95
	3	0.83	0.88	0.91
	4	0.79	0.85	0.89
	5	0.75	0.83	0.88
	6	0.73	0.82	0.87
1900/3300 Volt Cables	2	0.88	0.91	0.93
	3	0.80	0.85	0.88
	4	0.76	0.81	0.85
	5	0.72	0.78	0.83
	6	0.69	0.76	0.81

\* For high current carrying cables (i.e. large size) it is advisable to allow spacing between circuits. Alternatively the most appropriate group rating factor must be applied when determining the cable size and required number of cables in parallel.

### Cables Installed in Air

It is anticipated that many of the "in air" installations will be in buildings, and the ratings are therefore given in accordance with IEE Wiring Regulations for Electrical Installations, 16th Edition.

It should be noted that all ratings for cables run in free air have been based on the assumption that they are shielded from the direct rays of the sun without restriction of ventilation. The rating for cables subjected to direct sunlight should be reduced to take account of this factor and further guidance on this subject is available on request.

Table - 12

### Rating Factors for other Ambient Air Temperatures

Air Temperature	25°C	30°C	35°C	40°C	45°C	50°C	55°C
XLPE Insulated	1.02	1.0	0.96	0.91	0.87	0.82	0.76

### Defined Conditions of Installation

The 'in-air' current ratings given in relevant Tables are based on the installation conditions in air as follows:

#### (a) Single core cables

- (1) Two single core cables are installed one above the other, fixed to the vertical surface of a wall or open cable trench, the distance between the wall and the surface of the cable being not less than 20 mm.

Cables are installed at a distance between centres of twice the overall diameter of the cable, i.e. 2D, where D = overall diameter of cable.

- (2) Three single core cables are installed in trefoil formation, fixed to the vertical surface of a wall or open cable trench, the cables touching throughout and the distance between the wall and the surface of the nearest cable being not less than 20mm. The cables are assumed to be remote from iron, steel or ferro-concrete, other than the cable supports. Single core armoured cables to be electrically bonded at each end of the run.

#### (b) Multicore Cables

- Cables of all types other than single core cables are installed singly, fixed to the vertical surface of a wall or open cable trench, the distance between the surface of the cable and the wall being not less than 20 mm in every instance. If it is necessary for cables to be installed at distances less than those described above, then the values tabulated under the heading "Clipped direct to a surface..." in the IEE Wiring Regulations should be employed.

## Current Ratings (AC)

### Stranded Copper & Aluminium Conductors – Single Core Cables 600/1000 C Armoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV
50	235	235	222	0.87	0.93	0.87	175	180	162	1.40	1.60	1.40
70	290	280	285	0.62	0.70	0.62	220	220	207	0.98	1.00	0.98
95	345	330	346	0.47	0.56	0.47	260	260	252	0.72	0.79	0.74
120	390	370	402	0.39	0.48	0.39	295	295	292	0.58	0.66	0.60
150	435	405	463	0.33	0.43	0.33	330	330	337	0.48	0.57	0.49
185	490	440	529	0.28	0.39	0.28	375	365	391	0.39	0.49	0.41
240	560	500	625	0.24	0.35	0.24	435	410	465	0.31	0.42	0.34
300	630	550	720	0.21	0.32	0.21	490	455	540	0.27	0.38	0.29
400	700	580	815	0.20	0.30	0.20	540	480	625	0.35	0.38	0.25
500	770	620	918	0.18	0.28	0.18	580	510	714	0.31	0.35	0.22
630	840	670	1027	0.17	0.26	0.17	630	540	801	0.28	0.32	0.20
800	888	692	1119	0.17	0.25	0.17	-	-	-	-	-	-
1000	942	735	1214	0.16	0.24	0.16	-	-	-	-	-	-

### 600/1000 V Unarmoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	3D Installed in air amps	Ground mV	Duct mV	Air mV
50	230	240	209	0.85	0.93	0.87	175	180	159	1.40	1.50	1.45
70	285	295	270	0.61	0.70	0.61	215	220	206	0.98	1.10	0.98
95	335	345	330	0.45	0.56	0.45	255	260	253	0.71	0.79	0.73
120	385	395	385	0.36	0.48	0.37	295	300	296	0.57	0.66	0.59
150	435	445	445	0.31	0.43	0.31	325	335	343	0.47	0.57	0.47
185	490	500	511	0.26	0.39	0.26	370	375	395	0.39	0.49	0.39
240	570	580	606	0.22	0.35	0.22	430	440	471	0.31	0.42	0.32
300	650	650	701	0.19	0.32	0.20	490	510	544	0.26	0.38	0.27
400	740	750	820	0.17	0.30	0.18	550	570	638	0.36	0.38	0.23
500	840	850	936	0.16	0.28	0.16	620	640	743	0.33	0.35	0.20
630	960	960	1069	0.15	0.26	0.15	690	730	849	0.28	0.32	0.19
800	1120	1130	1214	0.15	0.25	0.15	-	-	-	-	-	-
1000	1300	1320	1349	0.14	0.24	0.14	-	-	-	-	-	-

Direct in ground - Trefoil touching  
Single way ducts - ducts touching  
Spacing in air - As shown above (D = Cable diameter)  
Non magnetic wire armour bonded at both ends

Installation conditions for above ratings: Ambient air temperature: 30°C  
Depth of laying: 0.5 m  
Soil thermal resistivity: 1.2°C m/W  
Maximum conductor operating temperature at rated current is 90°C For rating factors see Tables 2 to 6 and 8 to 12

## Current Ratings (AC)

### Stranded Copper & Aluminium Conductors – Two Core Cables 600/1000 V Armoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16*	140	115	115	2.9	2.9	2.9	-	-	-	-	-	-
25*	180	145	152	1.9	1.9	1.9	135	110	112	3.1	3.1	3.1
35*	215	175	188	1.3	1.3	1.3	165	130	138	2.2	2.2	2.2
50	255	210	288	1.0	1.0	1.0	195	155	166	1.7	1.7	1.7
70	315	260	291	0.7	0.7	0.7	240	195	211	1.1	1.1	1.1
95	381	313	354	0.5	0.5	0.5	288	237	254	0.8	0.8	0.8
120	410	344	430	0.4	0.4	0.4	-	-	-	-	-	-
150	472	384	480	0.4	0.4	0.4	-	-	-	-	-	-
185	539	432	540	0.3	0.3	0.3	-	-	-	-	-	-
240	632	504	636	0.2	0.2	0.2	-	-	-	-	-	-
300	708	560	732	0.2	0.2	0.2	-	-	-	-	-	-
800	888	692	1119	0.17	0.25	0.17	-	-	-	-	-	-
1000	942	735	1214	0.16	0.24	0.16	-	-	-	-	-	-

\* Circular conductor, all others are sector shaped

### 600/1000 V Unarmoured PVC Sheathed Cables

<table border

## Current Ratings (AC)

### Stranded Copper & Aluminium Conductors – Three Core Cables 600/1000 V Armoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	115	94	99	2.5	2.5	2.5	89	72	74	4.2	4.2	4.2
25	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2

### 600/1000 V Unarmoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	120	93	100	2.5	2.5	2.5	-	-	-	-	-	-
25	145	125	127	1.7	1.7	1.7	115	92	97	2.7	2.7	2.7
35	180	145	158	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	192	0.9	0.9	0.9	165	135	146	1.4	1.4	1.4
70	265	215	246	0.6	0.6	0.6	200	165	187	1.0	1.0	1.0
95	315	255	298	0.5	0.5	0.5	240	195	227	0.7	0.7	0.7
120	365	300	346	0.4	0.4	0.4	275	225	263	0.6	0.6	0.6
150	405	330	399	0.3	0.3	0.3	310	255	304	0.5	0.5	0.5
185	465	380	456	0.3	0.3	0.3	350	290	347	0.4	0.4	0.4
240	540	440	538	0.2	0.2	0.2	415	340	409	0.3	0.3	0.3
300	600	500	621	0.2	0.2	0.2	465	385	471	0.3	0.3	0.3
400	675	575	741	0.2	0.2	0.2	523	443	570	0.2	0.2	0.2

Direct in ground - Cables touching

Single way ducts - ducts touching

\* Circular conductors, all others are sector shaped

Note: Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m

Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

## Current Ratings (AC)

### Stranded Copper & Aluminium Conductors – Four Core Cables 600/1000 V Armoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
	Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
16	115	94	99	2.5	2.5	2.5	89	72	74	4.2	4.2	4.2
25	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2
500	720	605	800	0.2	0.2	0.2	561	470	618	0.2	0.2	0.2

### 600/1000 V Unarmoured PVC Sheathed Cables

Nominal area of conductor mm<sup>2</sup>	Stranded Copper Conductors						Stranded Aluminium Conductors					
Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre			
Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	





</tbl

## Current Ratings (AC)

### Stranded Copper & Aluminium Conductors Four Core Cables with Reduced Neutral Conductor 600/1000 V Armoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Nominal area of neutral conductor mm <sup>2</sup>	Stranded Copper Conductors						Aluminium Conductors					
		Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
		Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
25	16*	150	125	131	1.7	1.7	1.7	115	94	98	2.7	2.7	2.7
35	16*	180	150	162	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	25*	215	175	197	0.9	0.9	0.9	165	135	145	1.4	1.4	1.4
70	35*	265	215	251	0.6	0.6	0.6	200	165	185	1.0	1.0	1.0
95	50	315	260	304	0.5	0.5	0.5	240	200	224	0.7	0.7	0.7
120	70	360	300	353	0.4	0.4	0.4	275	230	264	0.6	0.6	0.6
150	70*	405	335	406	0.3	0.3	0.3	310	255	305	0.5	0.5	0.5
185	95	460	380	463	0.3	0.3	0.3	350	295	350	0.4	0.4	0.4
240	120*	530	440	546	0.2	0.2	0.2	410	340	418	0.3	0.3	0.3
300	150*	590	495	628	0.2	0.2	0.2	460	385	488	0.3	0.3	0.3
400	185*	667	570	728	0.2	0.2	0.2	520	443	562	0.2	0.2	0.2
500	240*	720	605	800	0.2	0.2	0.2	561	470	618	0.2	0.2	0.2

### 600/1000 V Unarmoured PVC Sheathed Cables

Nominal area of conductor mm <sup>2</sup>	Nominal area of neutral conductor mm <sup>2</sup>	Stranded Copper Conductors						Aluminium Conductors					
		Current Ratings			Approximate voltage drop per ampere per metre			Current Ratings			Approximate voltage drop per ampere per metre		
		Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV	Direct in ground amps	In single way ducts amps	Installed in air amps	Ground mV	Duct mV	Air mV
25	16*	145	125	127	1.7	1.7	1.7	115	92	97	2.7	2.7	2.7
35	16*	180	145	158	1.2	1.2	1.2	135	110	120	1.9	1.9	1.9
50	25*	215	175	192	0.9	0.9	0.9	165	135	146	1.4	1.4	1.4
70	35*	265	215	246	0.6	0.6	0.6	200	165	187	1.0	1.0	1.0
95	50	315	255	298	0.5	0.5	0.5	240	195	227	0.7	0.7	0.7
120	70	365	300	346	0.4	0.4	0.4	275	225	263	0.6	0.6	0.6
150	70*	405	330	399	0.3	0.3	0.3	310	255	304	0.5	0.5	0.5
185	95	465	380	456	0.3	0.3	0.3	350	290	347	0.4	0.4	0.4
240	120*	540	440	538	0.2	0.2	0.2	415	340	409	0.3	0.3	0.3
300	150*	600	500	621	0.2	0.2	0.2	465	385	471	0.3	0.3	0.3
400	185*	675	575	741	0.2	0.2	0.2	523	443	570	0.2	0.2	0.2
500	240*	730	610	814	0.2	0.2	0.2	565	470	626	0.2	0.2	0.2

Direct in ground - Cables touching

Single way ducts - ducts touching

\* Circular conductors, all others are sector shaped

Note: Unarmoured cables are as per IEC 60502 - 1

Installation conditions for above ratings:

Ambient air temperature: 30°C

Ground temperature: 15°C, Depth of laying: 0.5 m

Soil thermal resistivity: 1.2°C m/W

Maximum conductor operating temperature at rated current is 90°C

For rating factors see Tables 2 to 6 and 8 to 12

## XLPE Insulated Cables to BS 5467 & IEC - 60502 - 1

### Current Ratings (AC) and Volt Drops Stranded Copper Conductors 600/1000 V Three and Four Core Armoured, PVC Sheathed Cables

Conductor size mm <sup>2</sup>	Current in air A	Voltage drop mV/A/m	Current in ground A	Conductor size mm <sup>2</sup>	Current in air A	Voltage drop mV/A/m	Current in ground A
16	99	2.50	115	50	197	0.865	215
	97	2.50	112		190.0	.852	210
	93	2.47	110		180	0.839	200
	89	2.43	105		175	0.826	195
	84	2.39	100		165	0.813	190
	80	2.35	97		155	0.800	185
	74	2.31	94		145	0.787	175
	68	2.27	89		135	0.774	165
	62	2.23	84		120	0.761	155
25	131	1.65	150	70	251	0.607	265
	130	1.59	145		240	0.599	260
	125	1.56	140		230	0.589	250
	120	1.54	135		220	0.580	245
	110	1.51	130		210	0.572	235
	105	1.49	125		195	0.562	225
	99	1.46	120		185	0.554	215
	91	1.44	115		170	0.545	205
	82	1.41	110		150	0.536	195
35	162	1.15	180	95	304	0.446	315
	155	1.15	175		295	0.439	305
	150	1.13	170		290	0.433	300
	145	1.11	165		270	0.427	290
	135	1.09	160		255	0.421	280
	130	1.08	150		240	0.415	270
	120	1.06	145		225	0.408	255
	110	1.04	140		210	0.402	245
	100	1.02	130		190	0.396	230

Conductor size mm <sup>2</sup>	Current in air A	Voltage drop mV/A/m	Current in ground A
120	353	0.366	360
	340	0.357	350
	325	0.352	340
	310	0.347	330
	300	0.342	320
	280	0.337	305
	260	0.333	295
	240	0.328	280
	215	0.323	260
	406	0.303	405
150	395	0.299	395
	375	0.295	385
	365	0.292	370
	345	0.288	360
	325	0.284	345
	305	0.280	330
	280	0.277	315
	250	0.273	295
	463	0.255	460
	450	0.252	450
185	430	0.249	435
	415	0.246	420
	395	0.243	405
	370	0.240	390
	345	0.237	375
	320	0.235	355
	290	0.232	335

Conductor size mm <sup>2</sup>	Current in air A	Voltage drop mV/A/m	Current in ground A
240	546	0.211	530
	530	0.208	515
	510	0.206	500
	490	0.204	485
	465	0.203	470
	440	0.200	450
	410	0.199	430
	375	0.197	410
	340	0.195	385
	628	0.185	590
300	605	0.183	575
	580	0.181	560
	555	0.180	540
	530	0.179	520
	500	0.177	500
	465	0.176	480
	430	0.174	455
	390	0.174	430
	728	0.166	667
	715	0.163	640
400	685	0.162	620
	655	0.161	600
	620	0.160	580
	585	0.159	560
	545	0.158	535
	500	0.157	505
	450	0.156	475

Installation conditions for above ratings:

Ambient temperature: 30°C Ground Temperature: 15°C

Soil Thermal resistivity: 1.2°Cm/W

Depth of laying: 0.5 m

## Cables Constructions

### BS 5467 0.6/1KV Single Core Cu/XLPE/PVC/SWA/PVC

Nominal cross sectional area mm <sup>2</sup>	Nominal thickness of insulation mm	Thickness of bedding mm	Nominal AL wire armour dia. mm	Thickness of outer sheath mm	Approx. overall diameter mm	Approx. cable weight Kg/Km	Max. DC Resistance at 20°C Ohm/Km
50	1.0	0.8	0.9	1.5	16.5	1135	0.387
70	1.1	0.8	1.25	1.5	19.0	1525	0.268
95	1.1	0.8	1.25	1.6	21.0	1916	0.193
120	1.2	0.8	1.25	1.6	23.0	2418	0.153
150	1.4	1.0	1.6	1.7	25.5	2985	0.124
185	1.6	1.0	1.6	1.8	27.5	3422	0.0991
240	1.7	1.0	1.6	1.8	30.0	4641	0.0754
300	1.8	1.0	1.6	1.9	32.5	5282	0.0601
400	2.0	1.2	2.0	2.0	37.0	7049	0.0470
500	2.2	1.2	2.0	2.1	40.5	7645	0.0366
630	2.4	1.2	2.0	2.2	44.5	9681	0.0283
800	2.6	1.4	2.5	2.4	51.5	12090	0.0221
1000	2.8	1.4	2.5	2.5	56.5	14257	0.0176

### BS 5467 0.6/1 KV Two Core Cu/XLPE/PVC/SWA/PVC

1.5	0.7	0.8	0.9	1.3	12.0	409	12.1
2.5	0.7	0.8	0.9	1.4	13.0	465	7.41
4.0	0.7	0.8	0.9	1.4	14.0	567	4.61
6.0	0.7	0.8	0.9	1.4	15.0	679	3.08
10	0.7	0.8	0.9	1.5	17.0	846	1.83
16	0.7	0.8	1.25	1.5	19.5	1190	1.15
25	0.9	0.8	1.25	1.6	20.0	1265	0.727
35	0.9	1.0	1.6	1.7	22.0	1646	0.524
50	1.0	1.0	1.6	1.8	24.5	2065	0.387
70	1.1	1.0	1.6	1.9	27.0	2604	0.268
95	1.1	1.2	2.0	2.0	30.5	3506	0.193
120	1.2	1.2	2.0	2.1	33.0	4287	0.153
150	1.4	1.2	2.0	2.2	36.0	5041	0.124
185	1.6	1.4	2.5	2.4	40.5	6296	0.0991
240	1.7	1.4	2.5	2.5	44.0	8156	0.0754
300	1.8	1.6	2.5	2.6	47.5	9514	0.0601
400	2.0	1.6	2.5	2.8	53.0	11960	0.0470

### BS 5467 0.6/1 KV Three Core Cu/XLPE/PVC/SWA/PVC

1.5	0.7	0.8	0.9	1.3	12.5	437	12.1
2.5	0.7	0.8	0.9	1.4	13.5	502	7.41
4.0	0.7	0.8	0.9	1.4	14.5	623	4.61
6.0	0.7	0.8	0.9	1.4	15.5	744	3.08
10	0.7	0.8	1.25	1.5	18.5	1070	1.83
16	0.7	0.8	1.25	1.6	20.0	1330	1.15
25	0.9	1.0	1.6	1.7	23.0	1721	0.727
35	0.9	1.0	1.6	1.8	25.0	2111	0.524
50	1.0	1.0	1.6	1.8	27.5	2632	0.387
70	1.1	1.0	1.6	1.9	31.0	3385	0.268
95	1.1	1.2	2.0	2.1	35.0	4585	0.193
120	1.2	1.2	2.0	2.2	37.5	5617	0.153
150	1.4	1.4	2.5	2.3	42.0	7040	0.124
185	1.6	1.4	2.5	2.4	46.0	8286	0.0991
240	1.7	1.4	2.5	2.6	50.5	10769	0.0754
300	1.8	1.6	2.5	2.7	56.0	12797	0.0601
400	2.0	1.6	2.5	2.9	62.0	16043	0.0470

## Cables Constructions

**BS 5467 0.6/ 1 KV Four Core Cu/XLPE/PVC/SWA/PVC**

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal armour wire <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
1.5	0.7	0.8	0.9	1.3	13.0	474	12.1
2.5	0.7	0.8	0.9	1.4	14.0	586	7.41
4.0	0.7	0.8	0.9	1.4	15.5	725	4.61
6.0	0.7	0.8	1.25	1.5	17.5	967	3.08
10	0.7	0.8	1.25	1.5	20.0	1265	1.83
16	0.7	0.8	1.25	1.6	22.0	1572	1.15
25	0.9	1.0	1.6	1.7	25.0	2074	0.727
35	0.9	1.0	1.6	1.8	27.0	2567	0.524
50	1.0	1.0	1.6	1.9	30.5	3236	0.387
70	1.1	1.2	2.0	2.1	35.0	4538	0.268
95	1.1	1.2	2.0	2.2	38.5	5859	0.193
120	1.2	1.4	2.5	2.3	43.5	7459	0.153
150	1.4	1.4	2.5	2.4	46.5	8835	0.124
185	1.6	1.4	2.5	2.6	51.5	10965	0.0991
240	1.7	1.6	2.5	2.7	57.5	13522	0.0754
300	1.8	1.6	2.5	2.9	62.5	16489	0.0601
400	2.0	1.8	3.15	3.2	71.5	21046	0.0470


## Cables Constructions

**BS 5467 0.6/1 KV Control Cables Cu/XLPE/PVC/SWA/PVC**

Nominal cross sectional area <b>mm<sup>2</sup></b>	No. of cores	Nominal thickness of insulation <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal armour wire diameter <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
1.5	7	0.7	0.8	0.9	1.4	15.2	430	12.1
1.5	12	0.7	0.8	1.25	1.5	19.4	720	12.1
1.5	19	0.7	0.8	1.25	1.6	22.2	945	12.1
1.5	27	0.7	1.0	1.6	1.7	26.7	1405	12.1
1.5	37	0.7	1.0	1.6	1.7	29.0	1685	12.1
1.5	48	0.7	1.0	1.6	1.8	32.7	2040	12.1
2.5	7	0.7	0.8	0.9	1.4	17.1	555	7.41
2.5	12	0.7	0.8	1.25	1.6	22.4	950	7.41
2.5	19	0.7	1.0	1.6	1.7	26.6	1440	7.41
2.5	27	0.7	1.0	1.6	1.8	30.7	1860	7.41
2.5	37	0.7	1.0	1.6	1.8	33.8	2270	7.41
2.5	48	0.7	1.2	2.0	2.0	39.3	3105	7.41
4.0	7	0.7	0.8	1.25	1.5	19.7	820	4.61
4.0	12	0.7	1.0	1.6	1.6	25.7	1365	4.61
4.0	19	0.7	1.0	1.6	1.7	29.3	1820	4.61
4.0	27	0.7	1.0	1.6	1.9	34.4	2405	4.61
4.0	37	0.7	1.2	2.0	2.0	39.2	3315	4.61
4.0	48	0.7	1.2	2.0	2.1	44.1	4040	4.61

**BS 5467 0.6/ 1KV Four Core with Reduced Neutral Cu/XLPE/PVC/SWA/PVC**

Nominal cross sec. area <b>mm<sup>2</sup></b>	Nominal cross sec. area <b>mm<sup>2</sup></b>	Nominal thickness of insulation Phase <b>mm</b>	Nominal thickness of insulation Neutral <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal armour wire dia. <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
25	16	0.9	0.7	1.0	1.6	1.7	24.5	1990	0.727
35	16	0.9	0.7	1.0	1.6	1.8	27.0	2399	0.524
50	25	1.0	0.9	1.0	1.6	1.9	29.0	2930	0.387
70	35	1.1	0.9	1.2	2.0	2.0	33.5	4157	0.268
95	50	1.1	1.0	1.2	2.0	2.1	37.0	5357	0.193
120	70	1.2	1.1	1.2	2.0	2.2	40.5	6473	0.153
150	70	1.4	1.1	1.4	2.5	2.4	45.5	7896	0.124
185	95	1.6	1.1	1.4	2.5	2.5	49.5	9932	0.0991
240	120	1.7	1.2	1.6	2.5	2.6	55.0	12155	0.0754
300	150	1.8	1.4	1.6	2.5	2.8	60.5	14982	0.0601
400	185	2.0	1.6	1.6	2.5	3.0	66.5	18116	0.0470

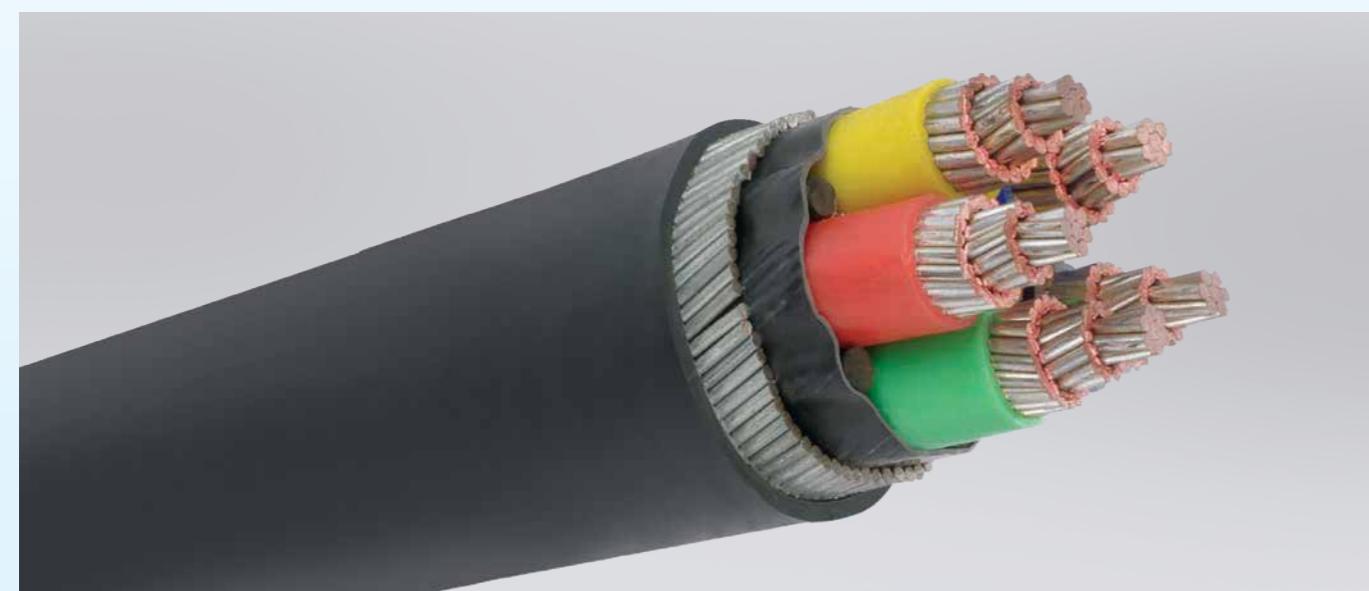

## PVC INSULATED ARMOURED CABLES



- Application**
- Indoors or Outdoors in cable ducts, cable trays, conduits or underground locations under mechanical stresses in power and switching stations.
  - Local distribution systems, Industrial and Commercial units for basic power & lighting purpose.

Standards	BS 6346, IEC 60502-1 & VDE 0271
Operating Temperature	70°C
Short Circuit Temp.	160°C
Working Voltage	600 / 1000 Volts
Test Voltage	3.5 KV rms for 5 minutes

### CONSTRUCTION

**Conductor** Aluminium / Annealed plain copper solid\* / stranded conductor conform to BS 6360 and IEC 60228, Class 2 (Circular / Sector shaped)

**Insulation** PVC type TI1 as per BS 7655: Section 3.1 and PVC type A as per IEC 60502-1

Single core	Red or Black
2 Core	Red , Black
3 Core	Red , Yellow , Blue
4 Core	Red , Yellow, Blue, Black
5 Core	Red , Yellow, Blue, Black & Yellow - Green
6 Core & above	Black colour with number printing

**Assembly** Insulated conductors are laid up together, if necessary interstices may be filled with fillers.

**Fillers** Non-hygroscopic Poly propylene fillers are included between laid up cores wherever required  
A separator tape of non-hygroscopic poly propylene material is applied over laid up cores wherever necessary.

**Bedding** Extruded PVC compatible with operating temperature.

**Armour** For Single Core - Aluminium round wire / flat wire.  
For Multicore - Galvanised Steel round wire / flat wire / tape.

**Outer Sheath** Extruded PVC / Special PVC compound such as Flame Retardant (FR), Flame Retardant Low Smoke (FRLS), Low Smoke Zero Halogen (LSOH) can be used for outer sheath to suit a variety of environment and fire risk conditions. Flammability test confirms to IEC 332 & Swidish chimeny. For installation where fire and associated problems such as emission of smoke and toxic fumes offer a serious potential threat, special LSF (Low smoke & fumes) compound can be provided. LSF compound is Halogen free (Flourine, Chlorine, Bromine) when tested as per BS 6425 (Pt 1) & IEC 60754 (Pt 1). The acid gas evolved during combustion is less than 0.5% by weight of material.

**Minimum Bending radius** :12 times the cable diameter

**Admissible Pulling Force** : Aluminium - 30N/mm<sup>2</sup>

### Cables Constructions

#### BS 6346 0.6/ 1 KV Single Core Cu/PVC/PVC/SWA/PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal AL armour wire diameter <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
50	1.4	0.8	1.25	1.5	18.5	780	0.387
70	1.4	0.8	1.25	1.6	20.5	1005	0.268
95	1.6	0.8	1.25	1.6	22.5	1288	0.193
120	1.6	1.0	1.6	1.7	26.0	1654	0.153
150	1.8	1.0	1.6	1.7	27.0	1969	0.124
185	2.0	1.0	1.6	1.8	29.5	2375	0.0991
240	2.2	1.0	1.6	1.9	32.5	2983	0.754
300	2.4	1.0	1.6	1.9	35.0	3607	0.0601
400	2.6	1.2	2.0	2.1	40.0	4794	0.0470
500	2.8	1.2	2.0	2.1	43.5	5848	0.0366
630	2.8	1.2	2.0	2.2	47.5	7154	0.0283
800	2.8	1.4	2.5	2.4	53.5	9087	0.0221
1000	3.0	1.4	2.5	2.5	59.5	11162	0.0176

#### BS 6346 0.6/ 1 KV Two Core Cu/PVC/PVC/SWA/PVC

1.5	0.8	0.8	0.9	1.4	12.0	258	12.1
2.5	0.8	0.8	0.9	1.4	13.5	311	7.41
4.0	1.0	0.8	0.9	1.4	15.0	431	4.61
6.0	1.0	0.8	0.9	1.5	16.0	516	3.08
10	1.0	0.8	1.25	1.6	20.0	826	1.83
16	1.0	0.8	1.25	1.6	22.0	1021	1.15
25	1.2	1.0	1.6	1.7	22.0	1208	0.727
35	1.2	1.0	1.6	1.8	24.0	1467	0.524
50	1.4	1.0	1.6	1.9	26.5	1864	0.387
70	1.4	1.0	1.6	1.9	28.5	2319	0.268
95	1.6	1.2	2.0	2.1	33.0	3187	0.193
120	1.6	1.2	2.0	2.2	35.5	3758	0.153
150	1.8	1.2	2.0	2.3	38.5	4485	0.124
185	2.0	1.4	2.5	2.4	43.5	5709	0.0991
240	2.2	1.4	2.5	2.5	47.0	6998	0.0754
300	2.4	1.6	2.5	2.7	51.5	8437	0.0601
400	2.6	1.6	2.5	2.9	56.5	10592	0.0470

#### BS 6346 0.6/ 1 KV Three Core Cu/PVC/PVC/SWA/PVC

1.5	0.8	0.8	0.9	1.4	12.5	287	12.1
2.5	0.8	0.8	0.9	1.4	14.0	357	7.41
4.0	1.0	0.8	0.9	1.4	15.5	490	4.61
6.0	1.0	0.8	1.25	1.5	17.5	689	3.08
10	1.0	0.8	1.25	1.6	21.0	957	1.83
16	1.0	0.8	1.25	1.6	23.0	1212	1.15
25	1.2	1.0	1.6	1.7	25.0	1577	0.727
35	1.2	1.0	1.6	1.8	26.5	1911	0.524
50	1.4	1.0	1.6	1.9	30.5	2522	0.387
70	1.4	1.2	2.0	2.0	34.0	3410	0.288
95	1.6	1.2	2.0	2.1	38.0	4349	0.193
120	1.6	1.2	2.0	2.2	40.5	5149	0.153
150	1.8	1.4	2.5	2.4	46.0	6648	0.124
185	2.0	1.4	2.5	2.5	50.0	7893	0.0991
240	2.2	1.6	2.5	2.6	54.5	9768	0.0754
300	2.4	1.6	2.5	2.8	61.0	11906	0.0601
400	2.6	1.6	2.5	3.0	66.5	14996	0.0470

Note : Unarmoured cables construction details available upon request.

\*Aluminium - upto 10 mm<sup>2</sup> Copper - upto 6 mm<sup>2</sup>

\*\*Modification which serve to improve our products will be implemented without notice.

## PVC Insulated Armoured Cables

BS 6346 0.6/ 1 KV Four Core Cu/PVC/PVC/SWA/PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	Nominal thickness of insulation <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal armour wire <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
1.5	0.8	0.8	0.9	1.4	13.5	329	12.1
2.5	0.8	0.8	0.9	1.4	15.0	411	7.41
4.0	1.0	0.8	1.25	1.5	18.0	670	4.61
6.0	1.0	0.8	1.25	1.5	19.0	806	3.08
10	1.0	0.8	1.25	1.6	22.5	1125	1.83
16	1.0	1.0	1.6	1.7	26.5	1623	1.15
25	1.2	1.0	1.6	1.8	27.0	1917	0.727
35	1.2	1.0	1.6	1.9	28.5	2364	0.524
50	1.4	1.2	2.0	2.0	34.0	3358	0.387
70	1.4	1.2	2.0	2.1	36.5	4238	0.268
95	1.6	1.2	2.0	2.2	41.5	5459	0.193
120	1.6	1.4	2.5	2.4	44.5	6545	0.153
150	1.8	1.4	2.5	2.5	49.5	8274	0.124
185	2.0	1.6	2.5	2.6	55.0	9989	0.0991
240	2.2	1.6	2.5	2.8	61.0	12436	0.0754
300	2.4	1.6	2.5	3.0	67.0	15141	0.0601
400	2.6	1.8	3.15	3.3	76.0	20181	0.0470


## Cables Constructions

0.6/1KV Auxillary Cables Cu/PVC/PVC/SWA/PVC

Nominal cross sectional area <b>mm<sup>2</sup></b>	No. of cores	Nominal thickness of insulation <b>mm</b>	Thickness of bedding <b>mm</b>	Nominal armour wire diameter <b>mm</b>	Thickness of outer sheath <b>mm</b>	Approx. overall diameter <b>mm</b>	Approx. cable weight <b>Kg/Km</b>	Max. DC Resistance at 20°C <b>Ohm/Km</b>
1.5	7	0.8	0.8	0.9	1.4	15.2	450	12.1
1.5	12	0.8	0.8	1.25	1.5	19.4	750	12.1
1.5	19	0.8	0.8	1.25	1.6	22.2	990	12.1
1.5	27	0.8	1.0	1.6	1.7	26.7	1470	12.1
1.5	37	0.8	1.0	1.6	1.8	29.2	1790	12.1
1.5	48	0.8	1.0	1.6	1.9	32.9	2170	12.1
2.5	7	0.8	0.8	1.25	1.5	18.0	680	7.41
2.5	12	0.8	0.8	1.25	1.6	22.4	995	7.41
2.5	19	0.8	1.0	1.6	1.7	26.6	1505	7.41
2.5	27	0.8	1.0	1.6	1.8	30.7	1985	7.41
2.5	37	0.8	1.0	1.6	1.9	34.0	2410	7.41
2.5	48	0.8	1.2	2.0	2.1	39.5	3290	7.41
4.0	7	1.0	0.8	1.25	1.6	20.5	890	4.61
4.0	12	1.0	1.0	1.6	1.7	26.8	1510	4.61
4.0	19	1.0	1.0	1.6	1.8	30.5	2015	4.61
4.0	27	1.0	1.2	2.0	2.0	37.1	2940	4.61
4.0	37	1.0	1.2	2.0	2.1	40.8	3660	4.61
4.0	48	1.0	1.2	2.0	2.2	46.0	4485	4.61

BS 6346 0.6/ 1 KV Four Core with Reduced Neutral Cu/PVC/PVC/SWA/PVC

Nominal cross sec. area	Nominal cross sec. area	Nominal thickness of insulation	Nominal thickness of insulation	Thickness of bedding	Nominal armour wire dia.	Thickness of outer sheath	Approx. overall diameter	Approx. cable weight	Max. DC Resistance at 20°C
Phase mm <sup>2</sup>	Neutral mm <sup>2</sup>	Phase mm	Neutral mm	mm	mm	mm	mm	Kg/Km	Ohm/Km
25	16	1.2	1.0	1.0	1.6	1.8	26.0	1799	0.727
35	16	1.2	1.0	1.0	1.6	1.8	27.5	2127	0.524
50	25	1.4	1.2	1.0	1.6	1.9	31.5	2807	0.387
70	35	1.4	1.2	1.2	2.0	2.0	35.5	3830	0.268
95	50	1.6	1.4	1.2	2.0	2.2	40.0	4966	0.193
120	70	1.6	1.4	1.4	2.5	2.3	44.0	6353	0.153
150	70	1.8	1.4	1.4	2.5	2.4	48.0	7445	0.124
185	95	2.0	1.6	1.4	2.5	2.5	52.5	8973	0.0991
240	120	2.2	1.6	1.6	2.5	2.7	59.0	11210	0.0754
300	150	2.4	1.8	1.6	2.5	2.9	64.0	13525	0.0601
400	185	2.6	2.0	1.8	3.15	3.1	71.5	17839	0.0470

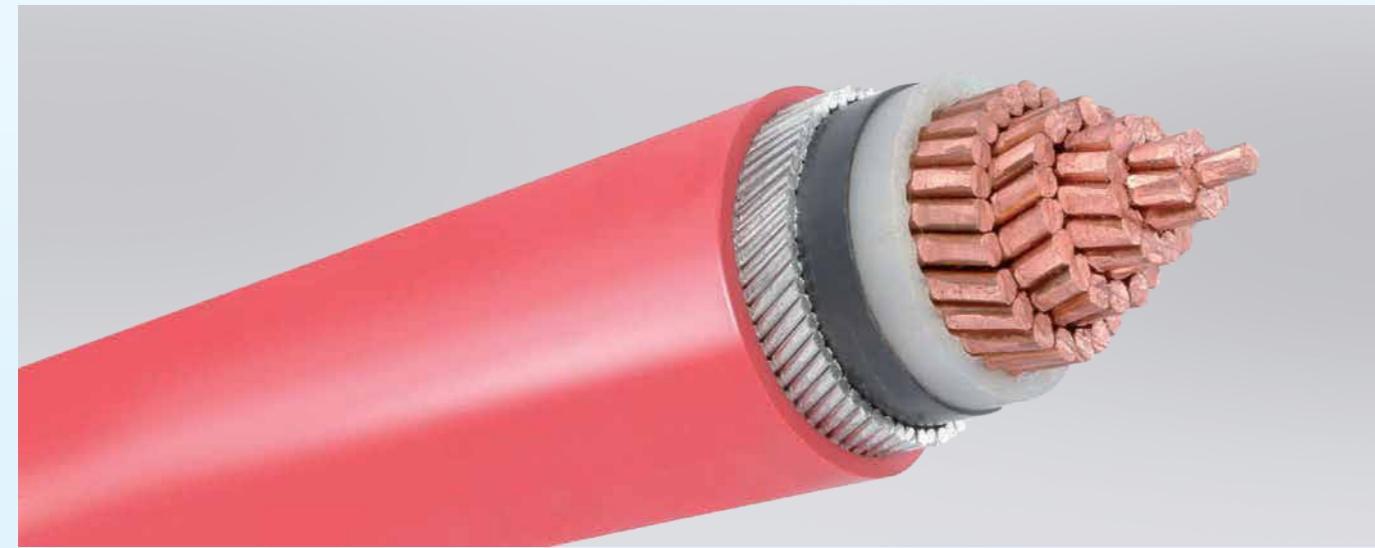

Current Ratings Copper Conductor PVC Insulated Armoured cable 600/1000 V

Conductor size	IN AIR			IN GROUND		
	Single Core		2-Core	Single Core		2-Core
	Trefoil	Flat		Trefoil	Flat	
mm <sup>2</sup>	(A)	(A)	(A)	(A)	(A)	(A)
16	-	-	97	83	-	-
25	-	-	128	110	-	-
35	-	-	157	135	-	-
50	181	230	190	163	203	211
70	231	286	241	207	248	257
95	280	338	291	251	297	305
120	324	385	336	290	337	341
150	373	436	386	332	376	377
185	425	490	439	378	423	417
240	501	566	516	445	485	469
300	567	616	592	510	542	515
400	657	674	683	590	600	549



## INSULATED FIXED / FLEXIBLE CORDS & WIRES



**Application** Installation in surface mounted or embedded conduits or similar closed systems. indoors, building wires, power cords and domestic electrical wiring purpose.

Standards	BS 6004, IEC 60227-3, BS 6007, BS 7919, BS 7211, BS 6231, BS 6141, BS 4737, BS 6500, <HAR>
Operating Temperature	70°C, 90°C
Working Voltage	300/500, 450/750 Volts
Maximum Short Circuit Temperature	160°C

**Test Voltage** After immerse in water for 12 hours test voltage applied for 5 minutes Thickness of insulation upto and including

0.7 mm	1.5 KV a.c.
0.7 mm to 1.0 mm	2.0 KV a.c.
1.0 mm and above	2.5 KV a.c.

**TYPE OF WIRES/CORDS** 2491LSF, 6491X, 6491LSF, 6241Y, 6242Y, 6243Y, 6181Y, 6181XY, 6181LSF, 318Y, 309Y, 218Y, 318LSF, 638TQ, 318TRS, 318TQ, 318XY, 380TQ, 680TQ,

**Conductor** Solid (class 1), Stranded (class 2), flexible (class 5), annealed copper conductor conforming to BS 6360 or IEC 60228

**Insulation** Poly Vinyl Chloride (PVC), Heat resistant (HR) PVC, Fire Retardant (FR) PVC, Fire Retardant Low Smoke (FRLS) PVC, Zero Halogen (LSOH), Thermosetting (XLPE, Rubber etc.)

**Colours** Green/Yellow, Blue, Red, Black, Grey, White, any other colours on request

**Sheath (Multicore)** Poly Vinyl Chloride (PVC), Heat resistant (HR) PVC, Fire Retardant (FR) PVC, Fire Retardant Low Smoke (FRLS) PVC, Zero Halogen (LSOH)

### Comparative Properties

Feature	HR PVC	FR-PVC	FRLS-PVC	LSOH
Temperature Rating	85°C	70°C	70°C	105°C
Requirement of Oxygen to catch Fire (% in air)	>21	>30	>30	>35
Temperature required to catch Fire				
Temp (with 21% in Oxygen)	Room Temp.	>250°C	>250°C	>300°C
Visibility during cable burning (%)	<20	<35	>40	>80
Release of Halogen Gas during burning (% by weight)	<20	<20	<20	ZERO
Flame Retardancy	Good	Very Good	Very Good	Excellent

FLEXIBLE & FLAT (RHINOS) 2, 3, 4, 6, 10, 12, 14, 16, 19, 24 & 27

(Details available on request).

## Cables Constructions

### 6491x : Copper Conductor, PVC Insulated Unsheathed Wires

Nominal cross section area of conductor mm <sup>2</sup>	Number/Nominal diameter of wires No/mm	Thickness of Insulation mm	Overall Diameter Max. mm	Current carrying capacity Amps	Resistance per Km at 20°C Ohms	Insulation resistance at 70°C M ohm-km
1.5	1/1.4 7/0.53 30/0.25	0.7	3.2 3.3 3.4	17.5 17.5 17.5	12.1 12.1 13.3	0.011 0.010 0.010
2.5	1/1.8 7/0.67 50/0.25	0.8	3.9 4.0 4.1	24 24 24	7.41 7.41 7.98	0.010 0.009 0.009
4.0	1/2.25 7/0.85 56/0.30	0.8	4.4 4.6 4.8	32 32 32	4.61 4.61 4.95	0.0085 0.0077 0.007
6.0	1/2.76 7/1.04 84/0.30	0.8	5.0 5.2 5.3	41 41 41	3.08 3.08 3.3	0.0070 0.0065 0.006
10	1/3.57 7/1.35 80/0.40	1.0	6.4 6.7 6.8	57 57 57	1.83 1.83 1.91	0.0070 0.0065 0.0056
16	7/170 126/0.40	1.0	7.8 8.1	76 76	1.15 1.21	0.0050 0.0046
25	7/2.14 196/0.40	1.2	9.7 10.2	101 101	0.727 0.78	0.0050 0.0044
35	7/2.58 276/0.40	1.2	10.9 11.7	125 125	0.524 0.554	0.0043 0.0038
50	19/1.78 396/0.40	1.4	12.8 13.9	151 151	0.387 0.386	0.0043 0.0037
70	19/2.14 360/0.50	1.4	14.6 16.0	192 192	0.268 0.272	0.0035 0.0032
95	19/2.52 475/0.50	1.6	17.1 18.2	232 232	0.193 0.206	0.0035 0.0032
120	37/2.03 608/0.50	1.6	18.8 20.2	269 269	0.153 0.161	0.0032 0.0029
150	37/2.25 756/0.50	1.8	20.9 22.5	300 300	0.124 0.129	0.0032 0.0029
185	37/2.52 925/0.50	2.0	23.3 24.9	341 341	0.099 0.106	0.0032 0.0029
240	61/2.25 1221/0.50	2.2	26.6 28.4	400 400	0.0754 0.0801	0.0032 0.0028
300	61/2.52	2.4	29.6	458	0.0601	0.0030
400	61/2.85	2.6	33.2	546	0.0470	0.0028



Note : The number and diameter of conductor strands are for reference only and governed by conductor

resistance. For other type of cords, wires, ECC, Flat, etc. the dimensions, parameters are available on request.

\*\*Modification which serve to improve our products will be implemented without notice.

## AERIAL BUNCHED CABLES

<b>Application:</b>	Outdoor distribution in Rural or residential areas Offers cost effective safer and reliable cable for reticulation.
<b>Range:</b>	LV Cables with XLPE, PVC or PE insulation MV cables with XLPE insulation
<b>Standard:</b>	<b>IS 14255, BS 7870-5, BS 625 HD 626, VDE 00276 P 626, IEC 60502 NF C 33-209</b>
<b>Voltage:</b>	600/1000V, 11KV, 22KV
<b>Conductor:</b>	Hard Drawn Aluminium, aluminium alloy or copper
<b>Insulation:</b>	Specially formulated for exposure to sunlight and outdoor application. LV XLPE or PE is loaded with carbon black MV cable insulated and screened cores are PVC sheathed
<b>Max Operating Temp:</b>	XLPE: Max 90°C PVC or PE: Max 70°C
<b>Construction:</b>	Insulated cores may be bundled together or laid up around high tensile insulated or bare messenger. If a messenger is provided; as the tension is taken by it, phase conductors can operate at maximum allowable conductor temperature.
<b>Minimum Bending Radius:</b>	For LV 10 times & MV 15 times cable diameter
<b>Solar Radiation:</b>	1000 W/ sq m



## Cables Construction

### LV Cables

Area (Sq. mm)	Strands	Conductor	Electrical Parameters		
			Current Rating In Air @ 30°C	Maximum DC Resistance @ 20°C	Reactance
16	7	87	1.91	0.091	2.84
25	7	107	1.20	0.087	4.17
35	7	132	0.868	0.085	5.78
50	7	165	0.641	0.083	8.45
70	19	205	0.443	0.0789	11.32
95	19	250	0.32	0.075	15.30
120	19	290	0.253	0.073	20.00
150	19	330	0.206	0.072	25.00

Current rating for max cond temp 80°C and wind velocity 1 km/hr



91 Bobbin Stranding Machine

## KEI RUBBER CABLES

In Keeping with the company's commitment to technological advancement, elastomer materials such as Ethylene Propylene Rubber "EPR", Polychloroprene "PCP", Chloro Sulphonated Polyethylene "CSP" Nitrile Rubber / PVC Blends, Ethylene Vinyl Acetate "EVA" and Silicone Rubber have been specially compounded to meet numerous heat oil and fire resisting requirements. In the recent years KEI has also developed special Elastomeric Fire Survival Cables for power, control and instrumentation wiring.

Elastomeric compounds for insulating and sheathing of cables are formulated to meet the requirement of BS 6899, IEC 60502 and IEC 60092 other international specification.

### GENERAL CONSTRUCTION "Conforming to IS 9968 Part I"

<b>Conductor</b>	Annealed tinned Copper wires Solid "Class 1", Stranded "Class 2" flexible "Class 5" complying with the requirement of BS 6360/IE 60228
<b>Seperator Tape</b>	Suitable Material Seperator Tape may be applied over the conductor.
<b>Insulation</b>	General Service elastomer compound / Heat Resisting elastomer compound / Silicone rubber as per IEC 60092 "351", BS-7655, VDE-0207Pt.-20
<b>Core Identification</b>	Coloured insulation, Nos. Polyester tape, Coloured proofed tape, Nos. printing.
<b>Fillers</b>	Natural or synthetic fibers or elastomer suitable for the operating temperature and compatible with the insulating material.
<b>Sheath</b>	General Service elastomeric compound / Heavy Duty elastomeric compound as per IEC 60092 "359", BS-7655, VDE 0207Pt.-21

### Working Temperature of Commonly Used Elastomeric Insulating and Sheathing Material

MATERIAL	Max. Cond. Temp. for continuous operation	Max. Cond. Temp. for short circuit	Min. Working Temp.
	Deg C.	Deg C.	Deg C.
Natural Rubber (VIR and TRS)	60	200	-55
Ethylene Propylene Rubber (EPR)	90	250	-50
Polychloroprene (PCP)	70	200	-40
Chlorosupphonated Polyethylene (CSP)	90	200	-35
Silicone Rubber	150 / 180	350	-55
HR Naural Ruber (HR VIR)	75	200	-55
Styrene Butadiene Rubber	60	200	-55
Butyl Rubber	85	220	-50



\*\*Modification which serve to improve our products will be implemented without notice.

## Cables Constructions

Elastomeric Cables Range	Application
Cables up to 11 KV	Machine Trailing, Mining, Power
Flexible Trailing Cables	Reeling unreeling, Trailing, Festooning, Mobile Machines, Cranes, Coal Handling and Conveyors
Mining Cables	FT or Pliable Armoured or Landline type as per IS 14494, NCB, SABS specs for UG, Open cast, Coal or other mines and mining machines
Thermal Power Plants	For coal handling plants, flexible power and control application
Cables for steel plants	Flexible and high temp withstandig cables for furnace, melting shops, material handling
Wind energy	Flexible cables for power and control for Wind Mill generator connection
Fire Survival Cables	Fire Survival for 3 Hrs or 20 Min
Ship wiring	As per IEC specs and Naval specs DGS of DEFSTAN, NES
OFFSHORE and ONSHORE	For platforms and Ring as per IEC, BS and NEK Specs
Shore Supply & Generator Cables	For charging of ship batteries and supply from mobile generators
Motor Coil Leads	Elastomeric and Silicon as per IS, BS, or OEM Specs
High Temp Cables	Silicon insulated, glass fiber braided or unbraided
Pump Cables	For Water, submersible and sewerage pumps
Cables for Railway	Coach wiring, Metro railway
Wire	HFFR Low toxic emission under fire
Panel Wiring	For flexible, high power high temp zone, polluted or moist atmospheres
Battery Cables	For High current and long life
Low Temperature installations	Suitable for subzero temp installations and operations
Misc. Applications	outdoor high mast lighting, site power supply, white goods, oil or chemical resistant
Type	Power and Control cables up to 61 Crores Instrumentation Pairs 30 pairs, triads, quad Wires, flat cables
Voltage Grades	11KV, 6.6KV, 3.3KV, 1.1KV, 750V, 250V, 110V, 60V
Conductor Range	0.5 to 630 Sq. mm
Polymers Processed COMPOUNDS	EPR, EPDM, PCP, CSP, CPE, SILICONE, EVA HALOGEN FREE AND FIRE RESISTANT NON TOXIC COMPOUNDS
Braiding Offered	ATC, GI wire braid, Synthetics or Textile Yarn, Glass Fiber
Armouring	Pliable armour or steel/copper wires/Stainless steel



Mica Taping Machine



Braiding Machine

## CABLES FOR INSTRUMENTATION

KEI manufactures a wide variety of cables suitable for process instrumentation, which plays a vital role in measurement, supervision and control of the process. Introduction of microprocessor based / computerized instrumentation has demanded stringent quality requirements along with special electrical parameters for instrumentation cables.



The cables used for instrumentation are designed and manufactured very meticulously. KEI maintains high quality standards and follow & stringent in-process quality control during manufacturing of instrumentation cables, meeting the design parameters of the customer.

<b>Conductor</b>	0.5 Sq. mm to 2.5 Sq mm of solid/stranded Tinned/untinned copper conductors.
<b>Insulation</b>	PVC/Polyethylene/XLPE/LSOH as per requirement.
<b>Elements / Core:</b>	Pair/Triad/Quad, colour coded / number printed.
<b>Screening</b>	Aluminium Polyester screen over all (collective) screen (OAS), individual screen (IS), or both IS & OAS with ATC drain wire. Wire braiding can also be given as per customer requirement.
<b>Element Laying</b>	Concentric formation or unit & group formation as per requirement.
<b>Armouring</b>	Unarmoured / Galvanised steel wire / Flat wire armoured.
<b>Sheathing</b>	PVC, FR PVC, FRLS, LSOH as per requirement.
<b>Specification</b>	EIL-6-52-46. Rev.05, BS: 5308 Part 1 & Part 2, BSC 143-0.75 (24/0.2 mm) OAS, IEC 60092-375, 376, BS EN 50288, VDE 0815, VG 95218, NEK 606 and customers Specifications.)



## Cables Construction

### Typical Instrumentation Cable Constructors

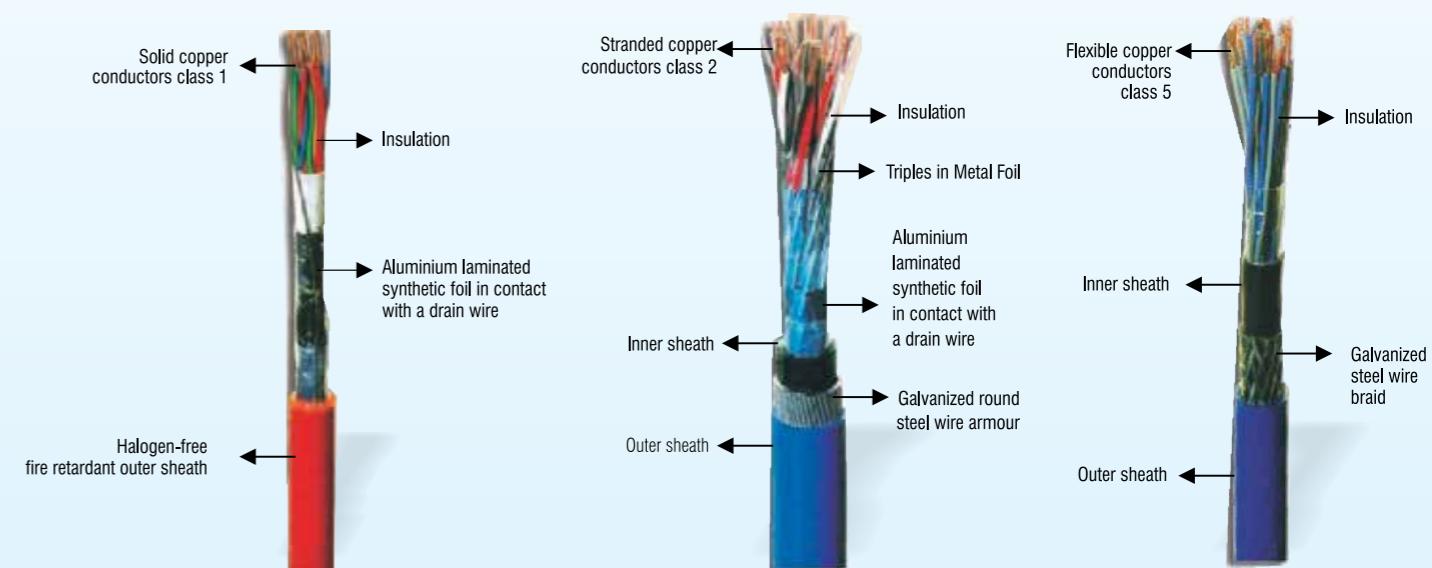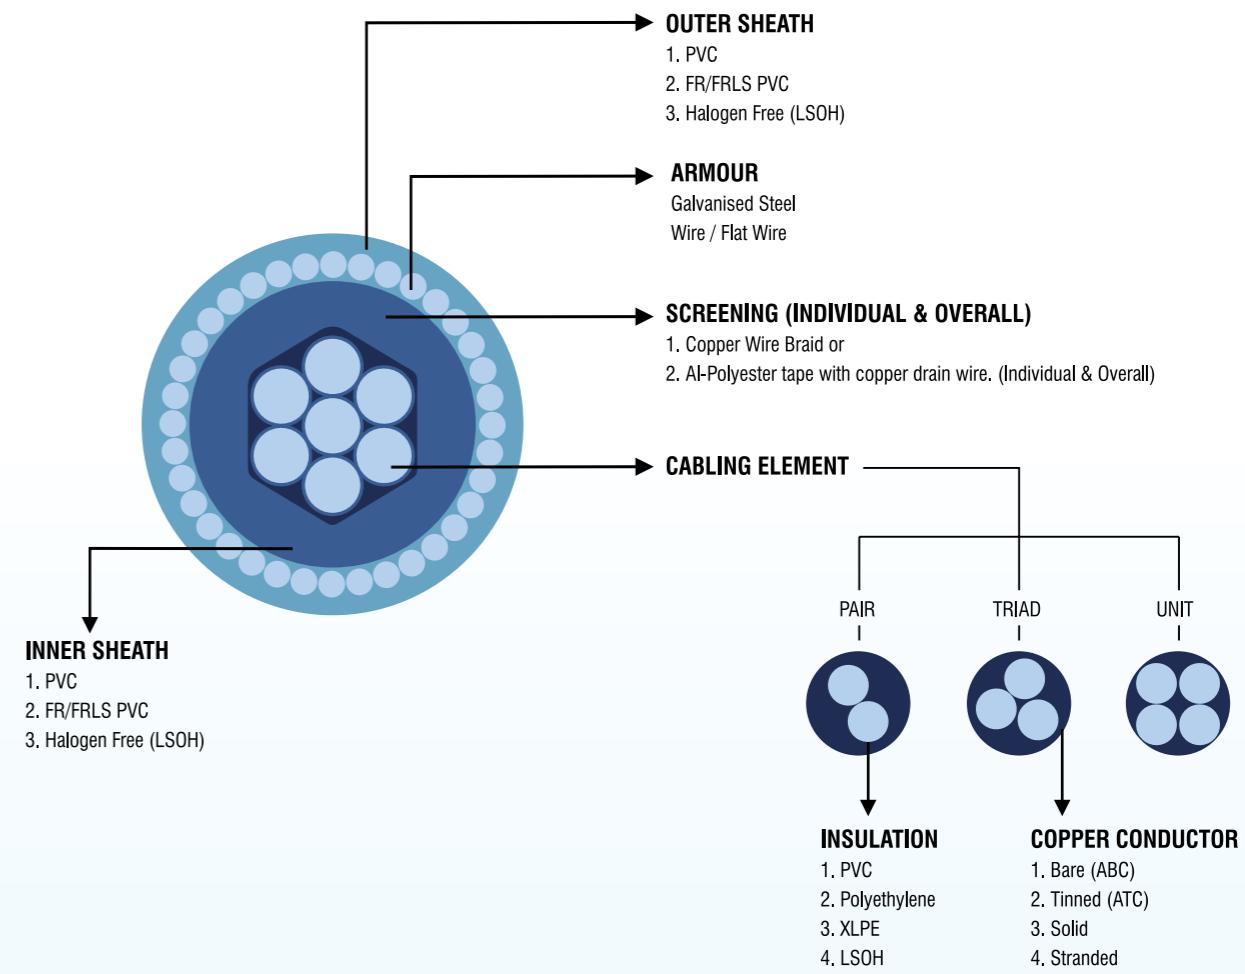

## THERMOCOUPLE EXTENSION / COMPENSATING CABLES

Thermocouple extension and compensating cables are designed for interconnection between thermocouple probes and control instrumentation. They are generally available in the following types:

### Type (1)

Unarmoured cables with conductors insulated with PVC and twisted together in pairs, sheathed overall with PVC.

### Type (2)


Armoured cables with conductors insulated with PVC and twisted together in pairs, PVC bedding, Galvanised steel wire armour and sheathed overall with PVC.

All of the above types of cables can be supplied unscreened or screened (individually, collectively or both) with an Aluminium Polyester tape screen incorporating tinned copper drain wire.

The construction is similar to paired instrumentation cable but the conductor material is different. Thermocouple are used in processes to sense temperature and is connected to the pyrometers for indication and control. The thermocouple and pyrometers are electrically connected by thermocouple extension/compensating cables. The conductors used for these cables are required to have similar thermo-electric (emf) properties as that of the thermocouple used for sensing the temperature.

### Range of Instrumentation Cables:

<b>Standard</b>	ANSI MC 96.1, BS-1843, IEC 60584-3, ENI
<b>Conductor</b>	Solid type as per type & mentioned in the table
<b>Insulation</b>	PVC/Polyethylene/XLPE/LSOH as per requirement.
<b>Elements</b>	Pairs colour coded/number printed.
<b>Screen</b>	Aluminium Polyester tape screen with Copper drain wire or alternately with Tinned Copper wire braiding. Individual element or overall screening as specified.
<b>Armouring</b>	Galvanised steel round wire / Flat wire.
<b>Sheathing</b>	PVC, FR PVC, FRLS, LSOH as per requirement.

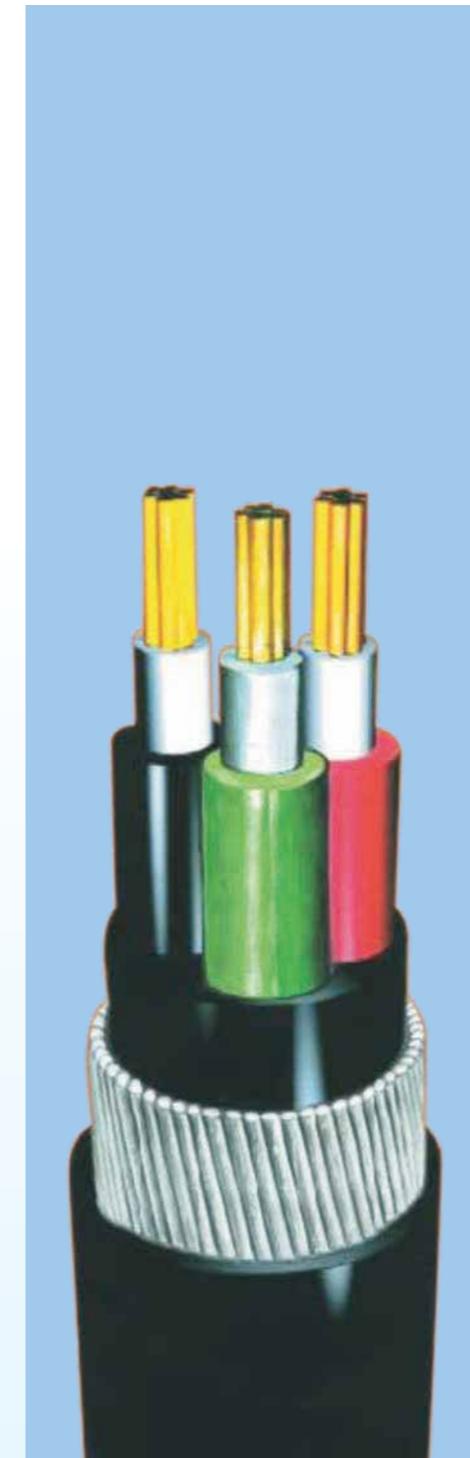

## SINGLE / MULTI CORE FIRE RESISTANT CABLES



### Core Identification :

- Red Black
- Red Yellow Blue
- Black Red Yellow Blue
- 7- 37 Cores white with Printed numbers
- Other Core colors available as per customer specification

### Cable Characteristics

<b>TEMPERATURE</b>	Range 25 to + 90°C
<b>BENDING RADIUS</b>	Circular conductor r=6D Shaped conductor r=8D
<b>MECHANICAL IMPACT</b>	Very Good
<b>FIRE PERFORMANCE</b>	BS 4066-1, BS4066-3
<b>FLEXIBILITY</b>	Rigid
<b>HALOGEN FREE</b>	BS6425-1
<b>LOW SMOKE</b>	Emissions BS 7622
<b>FIRE RESISTANT</b>	BS 6387



\*\*Modification which serve to improve our products will be implemented without notice.



\*\*Modification which serve to improve our products will be implemented without notice.

## Cables Constructions

### Single Core Fire Resistant Cables Low Voltage - 450/750 Volts

Nominal cross sectional area <b>mm<sup>2</sup></b>	Mean overall diameter <b>mm</b>	Approximate cable weight <b>kg/km</b>	Maximum conductor resistance at 20°C ohms/km (1 sec) <b>KA</b>	Short circuit rating DC or single phase AC <b>Amps</b>	Current rating Three phase AC <b>Amps</b>	Volt drop DC <b>mV/A/m</b>	Volt drop Single phase AC <b>mV/A/m</b>	Volt drop Three phase AC <b>mV/A/m</b>
+1	3.7	20	18.1	0.1	17	15	46	40
1.5	3.9	26	12.1	0.15	22	19	31	27
2.5	4.7	38	7.41	0.25	30	26	19	16
4.0	5.3	54	4.61	0.4	40	35	12	10
6.0	5.9	75	3.08	0.6	51	45	7.9	6.8
10	7.3	122	1.83	1.0	71	63	4.7	4.0
16	8.5	185	1.15	1.6	95	85	2.9	2.5
25	11.3	300	0.727	2.5	126	111	1.85	1.65
35	12.5	390	0.524	3.5	156	138	1.35	1.15
50	14.5	525	0.387	5.0	189	168	0.99	0.9
70	16.5	730	0.268	7.0	240	214	0.68	0.65
95	18.5	1000	0.193	9.5	290	259	0.49	0.58
120	20.5	1230	0.153	12	336	299	0.39	0.42
150	22.5	1520	0.124	15	375	328	0.32	0.37
185	25	1890	0.0991	18	426	370	0.25	0.32
240	28	2440	0.0754	24	500	433	0.19	0.33
300	31	3045	0.0601	30	573	493	0.155	0.31
400	35	3870	0.047	40	683	584	0.12	0.29
500	38.5	4930	0.0366	50	783	666	0.093	0.28
630	42.5	6280	0.0283	63	900	764	0.072	0.23

### Single / Multi Core Fire Resistant Cables

#### Three Core

Nominal cross sectional area <b>mm<sup>2</sup></b>	Approximate overall diameter <b>mm</b>	Approximate diameter under armour <b>mm</b>	Nominal diameter of armour wires <b>mm</b>	Approximate cable weight <b>kg/km</b>	Maximum conductor resistance at 20°C ohms/km <b>KA</b>	Short circuit rating (1 sec) of Conductor <b>Amps</b>	Current rating Three phase AC Clipped direct <b>Amps</b>	Current rating Three Phase AC Free Air <b>Amps</b>	Volt drop Three phase AC <b>mV/A/m</b>
+1	12.7	8.3	0.9	310	18.1	0.14	17	18	40
1.5	13.4	8.8	0.9	340	12.1	0.20	23	25	27
2.5	14.8	10.2	0.9	430	7.41	0.35	31	33	16
4.0	16.1	11.5	0.9	510	4.61	0.57	42	44	10
6.0	17.4	12.8	0.9	620	3.08	0.86	53	56	6.8
10	20.3	14.8	1.25	930	1.83	1.4	73	78	4.0
16	22.8	17.1	1.25	1210	1.15	2.2	94	99	2.5
25	27.4	20.8	1.6	1800	0.727	3.6	124	131	1.65
35	29.2	22.4	1.6	2100	0.524	5.0	154	162	1.15
50	33.0	26.2	1.6	2600	0.387	7.1	187	197	0.87
70	37.0	30.0	1.6	3400	0.268	10.0	238	251	0.60
95	40.6	32.4	2.0	4500	0.193	13.6	389	304	0.45
120	43.8	35.4	2.0	5500	0.153	17.2	335	353	0.37
150	48.0	38.4	2.5	6900	0.124	21.4	386	406	0.30
185	52.0	42.2	2.5	8200	0.0991	26.5	441	463	0.26
240	57.1	46.9	2.5	10200	0.0754	34.3	520	546	0.21
300	63.0	52.6	2.5	12200	0.0601	42.9	599	628	0.185
400	69.5	58.7	2.5	15000	0.0470	57.2	673	728	0.165

### Multi Core Fire Resistant Cables Low Voltage - 600/1000 Volts

Nominal cross sectional area <b>mm<sup>2</sup></b>	Approximate overall diameter <b>mm</b>	Approximate diameter under armour <b>mm</b>	Nominal cable weight <b>kg/km</b>	Approximate conductor resistance at 20°C ohms/km <b>KA</b>	Current rating DC or Single phase AC Clipped direct DC Free Air <b>Amps</b>	Current rating DC or Single phase AC <b>Amps</b>	Volt drop Single phase AC <b>mV/A/m</b>	Volt drop Three phase AC <b>mV/A/m</b>
<b>Two core</b>								
+1	12.2	7.8	0.9	280	18.1	18	21	47
1.5	12.9	8.3	0.9	310	12.1	27	29	31
2.5	14.1	9.6	0.9	380	7.41	36	39	19
4.0	15.2	10.6	0.9	450	4.61	49	52	12
6.0	16.4	12.0	0.9	530	3.08	62	66	7.9
10	18.6	14.0	0.9	630	1.83	85	90	4.7
16	21.4	15.9	0.9	920	1.15	110	115	2.9
25	22.0	16.3	1.25	1200	0.727	146	152	1.9
35	24.8	18.2	1.6	1600	0.524	180	188	1.35
50	28.0	21.2	1.6	2000	0.387	219	228	1.0
70	30.7	23.7	1.6	2400	0.268	279	291	0.67
95	35.3	27.3	2.0	3300	0.193	338	354	0.49
120	36.6	28.4	2.0	3800	0.153	392	410	0.42
150	39.3	30.9	2.0	4400	0.124	451	472	0.35
185	44.2	34.4	2.5	5700	0.0991	515	539	0.25
240	48.0	38.0	2.5	7200	0.0754	637	636	0.24
300	51.8	41.6	2.5	8300	0.0601	698	732	0.21
400	55.9	45.3	2.5	10500	0.047	787	847	0.19

#### Four core

Nominal cross sectional area <b>mm<sup>2</sup></b>	Approximate overall diameter <b>mm</b>	Approximate diameter under armour <b>mm</b>	Nominal diameter of armour wires <b>mm</b>	Approximate cable weight <b>kg/km</b>	Maximum conductor resistance at 20°C ohms/km <b>KA</b>	Short circuit rating (1 sec) of Conductor <b>Amps</b>	Current rating Three phase AC Clipped direct AC Free Air <b>Amps</b>	Current rating Three Phase AC Free Air <b>Amps</b>	Volt drop Three phase AC <b>mV/A/m</b>
+1	13.5	9.1	0.9	350	18.1	0.14	17	18	40
1.5	14.3	9.7	0.9	390	12.1	0.20	23	25	27
2.5	16.0	11.4	0.9	490	7.41	0.35	31	33	16
4.0	17.3	12.7	0.9	590	4.61	0.57	42	44	10
6.									

## Cables Constructions

Nominal cross sectional area	Approximate overall diameter	Approximate diameter under armour	Nominal diameter of armour wires	Approximate cable weight	Maximum conductor resistance at 20°C	Current rating DC or Single phase AC Clipped direct Free Air	Current rating DC or Single phase AC	Volt drop DC	Volt drop Single phase AC
mm <sup>2</sup>	mm	mm	mm	kg/km	ohms/km	Amps	Amps	mV/A/m	mV/A/m

### Seven core

+1	15.6	11.0	0.9	450	18.1	18 *	21 *	47	47
1.5	16.4	11.8	0.9	500	12.1	27 *	29 *	31	31
2.5	18.3	13.7	0.9	640	7.41	36 *	39 *	19	19
4.0	20.8	15.3	1.25	910	4.61	49 *	52 *	12	12

### Twelve core

+1	20.1	14.6	1.25	750	18.1	18 *	21 *	47	47
1.5	21.2	15.7	1.25	850	12.1	27 *	29 *	31	31
2.5	24.0	18.3	1.25	1090	7.41	36 *	39 *	19	19
4.0	27.3	20.9	1.6	1550	4.61	49 *	52 *	12	12

### Nineteen core

+1	22.8	17.1	1.25	970	18.1	18 *	21 *	47	47
1.5	24.2	18.5	1.25	1120	12.1	27 *	29 *	31	31
2.5	28.6	22.0	1.6	1650	7.41	36 *	39 *	19	19

### Twenty-seven core

+1	27.7	21.1	1.6	1430	18.1	18 *	21 *	47	47
1.5	29.4	22.8	1.6	1650	12.1	27 *	29 *	31	31
2.5	33.4	26.6	1.6	2150	7.41	36 *	39 *	19	19

### Thirty-seven core

+1	30.6	23.7	1.6	1700	18.1	18 *	21 *	47	47
1.5	32.2	25.6	1.6	2000	12.1	27 *	29 *	31	31
2.5	36.7	29.9	1.6	2650	7.41	36 *	39 *	19	19

Circular conductor 1.0-16mm<sup>2</sup>, Shaped conductor >= 25mm<sup>2</sup>. Installation methods for current rating in accordance with BS7671/IEE Wiring Regulations \*.

The tabulated rating is as a two core cable and may be used where the number of cores carrying current does not exceed the square root of the total number of cores. +Size not included in BS7846

Installation methods for current rating "Enclosed in conduit on a wall or in trunking" in accordance with BS7671/EE Wiring Regulations. The tabulated ratings are based upon a 30°C ambient temperature and 90°C operating temperature. For other ambient temperatures or where several circuits are grouped together, the following rating factor should be applied.

#### Temperature rating factors

Ambient Temperature °C	25	30	35	40	45	50	55	60
Rating factor	1.02	1.00	0.96	0.91	0.87	0.82	0.76	0.71

#### Correction factors for groupings

Number of circuits	2	3	4	5	6	7	8	9
Rating factor	0.80	0.70	0.65	0.60	0.57	0.54	0.52	0.50

# KEI Industries Limited

REGISTERED AND CORPORATE OFFICE:

D-90, OKHLA INDUSTRIAL AREA PHASE-I, NEW DELHI-110020, TEL: +91-11-26818840/8642/0242 FAX: 26817225, 26811959

E-MAIL: info@kei-ind.com WEBSITE: www.kei-ind.com CIN NO: L74899DL1992PLC051527

## Manufacturing Units

### Bhiwadi

KEI Industries Limited  
SP-919/920/922, Ricco Industrial Area,  
Phase-III, Bhiwadi, Distt. Alwar-301019 Rajasthan  
Tel: +91-1493-220106/221731  
Fax: 221731 E-Mail: bhiwadi@kei-ind.com

### Pathredi

KEI Industries Limited  
Plot No.SP2-874, Ind. Area Pathredi-301019  
Bhiwadi (Alwar) Rajasthan (India) Tel: 9828588579

### Silvassa

KEI Industries Limited  
99/27, Madhuban Industrial Estate, Rakholi,  
Silvassa-396230 Dadra & Nagar Haveli  
Tel: +91-260-2644404/2630944  
Fax: 2645896 E-Mail: silvassa@kei-ind.com

### Chinchpada

KEI Industries Limited  
Survey No. 1/1/2/5, Village Chinchpada,  
Silvassa-396230, Dadra Nagar Haveli (UT)  
Tel: 7574881215 E-Mail: silvassa@kei-ind.com

### Chopanki

KEI Industries Limited  
A-280/281/282/283/284, Ricco Industrial Area  
(Chopanki) Distt. Alwar-301019 Rajasthan  
Tel: +91-1493-260202/06 Fax: 260203  
E-mail: chopanki@kei-ind.com

## Marketing Offices (India)

### WEST

#### Marketing Office-Mumbai

KEI Industries Limited  
Nirvan Corporate, 7th Floor, Opposite Aghadi Nagar,  
Pump House, Jijamata Road, Andheri East,  
Mumbai-400093  
Tel: +91-22-28239673, 28375642  
Fax: +91-22-28258277 E-Mail: mumbai@kei-ind.com

#### Ahmedabad

KEI Industries limited  
301, Sarthik Complex, Opp. ISCKON BRTS,  
Satellite Road, Ahmedabad-380015, Tel: 9825795673  
E-Mail: dharmin.maniar@kei-ind.com, ahmedabad@kei-ind.com

#### Pune

KEI Industries Limited  
Vasudha Equinox, Office No. 104, 1st Floor,  
Mouje Bopodi, Near Khadki Railway Station, Pune-411003  
Tel: 9922722378  
E-Mail: srivastav.prashant@kei-ind.com

#### Nagpur

KEI Industries Limited  
103, Misal Layout, Near Maharashtra School  
Nagpur - 440014 E-Mail: nagpur@kei-ind.com  
Mr. Saranjeet S. Kohli, Tel: +91-9822473774  
E-Mail: saranjeet.kohli@kei-ind.com

#### Kolhapur

KEI Industries Limited, 776/ 3/6 AmarnathHights Building,  
Near AmarnathMandir Ganesh Colony, Kalambra Road,  
Kolhapur - 416007  
Mr. Rajaram B. Kamble Tel: 9371104263 / 8291918940  
E-Mail: kolhapur@kei-ind.com, rajaram.kamble@kei-ind.com

### NORTH

#### Jaipur

KEI Industries Limited  
Shivam Business Center, 405, 4th Floor,  
Calgary Hospital Road, Pradhan Marg,  
Malviya Nagar, Jaipur - 302017 (Rajasthan)  
Phone No. + 91 141 5179279 Fax: +91 141 252 9404  
Tel: +91 99290 93711 E-Mail : jaipur@kei-ind.com

#### Panipat

KEI Industries Limited  
JP Tower, First Floor, Tau Devi Lal Complex  
Panipat-132013 Tel: +91-9050417107  
E-mail: shakti.sharma@kei-ind.com

### SOUTH

#### Chennai

KEI Industries Limited  
No.4, (Old. No. 23) SIR C P Ramasamy Road,  
2nd Floor, Near Apollo Spectra Hospital  
Alwarpet, Chennai-600018  
Tel: +91-44-42009120  
Fax: +91-44-42009130; 8939768405  
E-Mail: victor@kei-ind.com, chennai@kei-ind.com

#### Cochin

KEI Industries Limited  
Ward No.18/555 and 18/556, NAD Thorappu,  
Near Kuzhikkattukara Jama Masjid,  
Edathala, Ernakulam, Kerala – 683563  
Tel: 9645096420 , E-Mail : cochin@kei-ind.com

### EAST

#### Bhubaneshwar

KEI Industries Limited  
Plot No- 139, 3rd Floor, Rose Dale District Centre,  
Chandrashekharpur, Bhubaneswar-751016, Odisha  
Tel: 9937035537  
E-Mail: odisha@kei-ind.com

#### Patna

KEI Industries Limited  
HIG Plot No-4H/59, Bahadurpur Housing Colony,  
Lohia Nagar, Agamkuan, Patna 800026, Bihar  
Tel: + 91 95348 38038, 7360042598  
E-Mail: bihar@kei-ind.com

## Marketing Office (Overseas)

#### Dubai

KEI Industries Limited  
Office -27, LOB 10, PO Box - 261739, JAFZA, Dubai UAE.  
Tel : +971-48812310, Fax : +971-48812311, Mobile : +971-564853435  
Email: dubai@kei-ind.com  
Contact : Mr. Devaraj Tigaiya

#### South Africa

KEI Cables SA (Pty) Ltd.  
Unit 27-4, Fish Eagle View, 1 Benacre Lane,  
Modderfontein, 1609, South Africa  
Ms. Thavashnee Pillay +27 83 235 2895

### Lucknow

KEI Industries Limited  
E-79,80,81 Transport Nagar (Kanpur Road)  
Lucknow (UP)-226012 Tel: 0522-4010752  
E-Mail: up@kei-ind.com

### Kanpur

KEI Industries Limited  
15/240 F, In Front of Hotel Attic, Civil Lines, Kanpur  
(UP)-208001 Tel: 9935062910

### Chandigarh

KEI Industries Limited  
SCO 17, 1st Floor, Swastik Vihar, MDC, Sector-5,  
Panchkula-134109 Tel: +91-172-4416301, 4416300,  
9872974996, 9872581422 E-Mail: chandigarh@kei-ind.com

### Hyderabad

KEI Industries Limited  
Plot No. 76, H.No. 3-14-52/1, Shubodaya Colony,  
Near M.E Reddy Function Hall, Mansoorabad,  
Vanasthalipuram, Hyderabad-500070  
Tel: +91 88860 63702, +91 99855 77886  
E-Mail: hyderabad@kei-ind.com

### Guwahati

KEI Industries Limited, Mangalam Plaza  
Compound, Near Nort East Weight Bridge, NH-37  
Bye Pass, Beltola, Guwahati-781029 Assam  
Rubul Gogoi – 8134846024, 9706050041  
E-Mail: rubul@kei-ind.com

### Ranchi

KEI Industries Limited  
Golden Camp Warehouse, Old H B Road  
Kokar, Ranchi, Jharkhand - 834001  
Tel: 9810492658, 8918904901  
E-Mail : jharkhand@kei-ind.com

### Singapore

KEI Industries Limited  
No.52, UBI Avenue 3, # 04-37 Frontier,  
Singapore-408867 Tel: +65 83240193  
Contact: Mr. Xavier Toh Hong Ghee  
E-mail: xavier@kei-sin.com

### Nigeria

(Marketing Representative)  
E-mail: kunal.gupta@kei-ind.com  
Tel: +234 809 9777786

### Nasik

KEI Industries Limited  
4, Sanket Apartment, Tidake Colony,  
Behind Hyundai Showroom, Nashik,  
Maharashtra-422002  
Tel: 8805369705 / 8291918949  
E-Mail: ghanshyam.pardeshi@kei-ind.com

### Baroda

KEI Industries Limited  
803-804, Siddharth Complex, Near Hotel Express  
R.C. Dutt Road, Baroda-390007  
Tel: +91-265-6539719, 2341831, 9824676443,  
9327476732, E-Mail: baroda@kei-ind.com,  
amit.gohil@kei-ind.com

### Surat

KEI Industries Limited  
703, Royal Trade Centre, Opposite Star Bazar,  
Adajan-Hazira Road, Adajan, Surat-395009  
Tel: 09879018448, +91-261-2793279  
E-Mail: rakesh.patel@kei-ind.com

### Aurangabad

KEI Industries Limited  
Mahesh Pandurang Akalekar, Flat No. 11, Padmini Housing Society,  
Nakshatra Park, Beside Walni Naka, Paithan Road,  
Aurangabad- 431 005  
Tel: 07045922707/706, 9075008151  
E-Mail: aurangabad@kei-ind.com, mahesh.akalekar@kei-ind.com

### Noida

KEI Industries Limited A-43 Ground Floor, Sector-64,  
Noida, UP-201301 Tel: 0120-4315467

### Indore

KEI Industries Limited  
Plot No 451 Sch No 78 Industrial Area New Loha Mandi  
Dewas Naka Indore 452010 (M.P)Tel: 9826588885

### Gurgaon

KEI Industries Limited  
Shop no-101 1st Floor, Radha Palace  
Gurdwara Road, Gurgaon Haryana-122001  
Tel: +919873561757 E-Mail: rk singh@kei-ind.com

### Dehradun

KEI Industries Limited  
H.No. - 329, Lane No- 13, Mohit Nagar,  
Dehradun - 248001 (U.K.), Ph.: 0135-2762223.  
Tel: 9756621171 E-Mail: depotdehradun@kei-ind.com

### Secunderabad

KEI Industries Limited  
5-2-510, 2nd floor, plot no: 44, Beside Govt Primary  
School, Near Bible House, Hyderbaste, R.P. Road,  
Secunderabad, Telangana- 500003 Tel: 8008005083,  
9963530111 E-Mail: Kiran.kumar@kei-ind.com

### Coimbatore

KEI Industries Limited, SF.no. 581/A, K.N.G. Pudur Road,  
Kanuvai Post S.M. Palayam Village, Coimbatore-641008  
Tel: 9443324217, E-Mail: manohar.s@kei-ind.com

### Vijayawada

KEI Industries Limited  
Venkata Ramana Enclave, D.No. 48-18-2a/1,  
2nd Floor -Nagarjuna Nagar Colony, 6th Lane, Behind  
Sai Baba Temple, Besides Ayush Hospital Krishna  
Dist., Andhra Pradesh-520008 Tel.: 8886063715  
E-Mail: syed.mahamood@kei-ind.com

### Kolkata

KEI Industries Limited  
Arihanth Benchmark, 4th Floor 113-F Matheshwariola  
Road Ps:Tiljala, Kolkata: 700046  
Tel: 033-4062 0820 / 4062 0822, 9932449183  
E-Mail: kolkata@kei-ind.com

### Siliguri

KEI Industries Limited, 8, Balai Das Chatterjee Road,  
Ground Floor, Hakimpura, (Opp. Relief Physiotherapy  
Centre) Dist-Darjeeling, Siliguri-734001, West Bengal  
Tel: 6292209825, E-Mail: dibyojoiti.karmakar@kei-ind.com

### Korea (Local Representative)

Contact: Mr. CH Han  
E-mail: ch.han@kei-ind.com  
Tel: +82-10-4351-8585  
Mr. TH Park  
E-mail: th.park@kei-ind.com Contact : +82-10-9104-4519